

# CITY OF LAGO VISTA WATER & WASTEWATER REPORT

September 2024



## Water Production

| This Month    |           | Total Production - 47.864 MG |            |             |             |            |
|---------------|-----------|------------------------------|------------|-------------|-------------|------------|
|               | Raw Water | Production                   | Efficiency | Highest Day | Average Day | Lowest Day |
| Water Plant 1 | 21.205 MG | 19.761 MG                    | 93.2%      | 0.799 MG    | 0.659 MG    | 0.473 MG   |
| Water Plant 2 | 0.000 MG  | 0.000 MG                     | ∞%         | --- MG      | 0.000 MG    | --- MG     |
| Water Plant 3 | 28.396 MG | 28.103 MG                    | 99.0%      | 1.192 MG    | 0.937 MG    | 0.753 MG   |
| Combined      | 49.601 MG | 47.864 MG                    | 96.5%      | 1.890 MG    | 1.595 MG    | 1.231 MG   |

| Past 12 Months |            | Total Production - 481.478 MG |            |             |             |            |
|----------------|------------|-------------------------------|------------|-------------|-------------|------------|
|                | Raw Water  | Production                    | Efficiency | Highest Day | Average Day | Lowest Day |
| Water Plant 1  | 171.169 MG | 155.843 MG                    | 91.0%      | 0.845 MG    | 0.426 MG    | 0.133 MG   |
| Water Plant 2  | 0.000 MG   | 0.000 MG                      | ∞%         | --- MG      | 0.000 MG    | --- MG     |
| Water Plant 3  | 329.751 MG | 325.635 MG                    | 98.8%      | 1.455 MG    | 0.890 MG    | 0.578 MG   |
| Combined       | 500.919 MG | 481.478 MG                    | 96.1%      | 2.200 MG    | 1.316 MG    | 0.797 MG   |

## Waste Water Treatment

| This Month                  |           | Total Treated - 16.627 MG |             |            |  |
|-----------------------------|-----------|---------------------------|-------------|------------|--|
|                             | Treated   | Highest Day               | Average Day | Lowest Day |  |
| Waste Water Treatment Plant | 16.627 MG | 0.730 MG                  | 0.554 MG    | 0.450 MG   |  |

| Past 12 Months              |            | Total Treated - 207.223 MG |             |            |  |
|-----------------------------|------------|----------------------------|-------------|------------|--|
|                             | Treated    | Highest Day                | Average Day | Lowest Day |  |
| Waste Water Treatment Plant | 207.223 MG | 0.748 MG                   | 0.566 MG    | 0.410 MG   |  |

## Effluent Disposal


| This Month                     |           | WWTP Plant Permit Total - 16.627 MG |             |            |  |
|--------------------------------|-----------|-------------------------------------|-------------|------------|--|
|                                | Total     | Highest Day                         | Average Day | Lowest Day |  |
| Lago Vista Golf Course Permit  | 4.633 MG  | 0.359 MG                            | 0.154 MG    | 0.060 MG   |  |
| Cedar Breaks Permit            | 4.363 MG  | 0.799 MG                            | 0.145 MG    | 0.000 MG   |  |
| WWTP Plant Permit Total        | 16.627 MG | 0.730 MG                            | 0.554 MG    | 0.450 MG   |  |
| Reclaimed Effluent 210A Permit | 0.000 MG  | 0.000 MG                            | 0.000 MG    | 0.000 MG   |  |

| Past 12 Months                 |            | WWTP Plant Permit Total - 207.223 MG |             |            |  |
|--------------------------------|------------|--------------------------------------|-------------|------------|--|
|                                | Total      | Highest Day                          | Average Day | Lowest Day |  |
| Lago Vista Golf Course Permit  | 48.175 MG  | 2.892 MG                             | 0.132 MG    | 0.000 MG   |  |
| Cedar Breaks Permit            | 51.390 MG  | 30.378 MG                            | 0.140 MG    | -30.378 MG |  |
| WWTP Plant Permit Total        | 207.223 MG | 0.749 MG                             | 0.566 MG    | 0.410 MG   |  |
| Reclaimed Effluent 210A Permit | 0.000 MG   | 0.000 MG                             | 0.000 MG    | 0.000 MG   |  |

## Combined Water Production

This Month

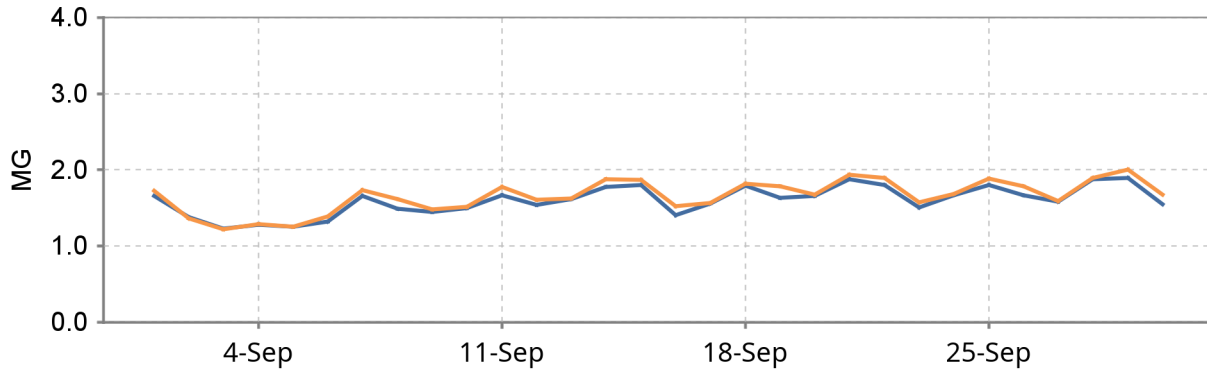


| Date       | WP1 Raw | WP2 Raw | WP3 Raw | Combined Raw | WP1 Finished | WP2 Finished | WP3 Finished | Combined Finished |
|------------|---------|---------|---------|--------------|--------------|--------------|--------------|-------------------|
| 09/01/24   | 0.714   | ---     | 1.011   | 1.725        | 0.706        | ---          | 0.955        | 1.661             |
| 09/02/24   | 0.563   | ---     | 0.800   | 1.363        | 0.592        | ---          | 0.788        | 1.380             |
| 09/03/24   | 0.468   | ---     | 0.748   | 1.216        | 0.473        | ---          | 0.758        | 1.231             |
| 09/04/24   | 0.479   | ---     | 0.804   | 1.283        | 0.486        | ---          | 0.789        | 1.275             |
| 09/05/24   | 0.530   | ---     | 0.725   | 1.255        | 0.501        | ---          | 0.753        | 1.254             |
| 09/06/24   | 0.620   | ---     | 0.765   | 1.385        | 0.568        | ---          | 0.755        | 1.323             |
| 09/07/24   | 0.748   | ---     | 0.989   | 1.737        | 0.671        | ---          | 0.985        | 1.657             |
| 09/08/24   | 0.694   | ---     | 0.922   | 1.616        | 0.606        | ---          | 0.883        | 1.488             |
| 09/09/24   | 0.647   | ---     | 0.834   | 1.482        | 0.628        | ---          | 0.820        | 1.448             |
| 09/10/24   | 0.678   | ---     | 0.833   | 1.511        | 0.618        | ---          | 0.881        | 1.500             |
| 09/11/24   | 0.795   | ---     | 0.979   | 1.774        | 0.718        | ---          | 0.951        | 1.669             |
| 09/12/24   | 0.718   | ---     | 0.886   | 1.604        | 0.665        | ---          | 0.871        | 1.536             |
| 09/13/24   | 0.677   | ---     | 0.949   | 1.626        | 0.662        | ---          | 0.955        | 1.617             |
| 09/14/24   | 0.793   | ---     | 1.083   | 1.877        | 0.721        | ---          | 1.058        | 1.779             |
| 09/15/24   | 0.815   | ---     | 1.054   | 1.868        | 0.733        | ---          | 1.071        | 1.804             |
| 09/16/24   | 0.646   | ---     | 0.876   | 1.522        | 0.594        | ---          | 0.809        | 1.403             |
| 09/17/24   | 0.667   | ---     | 0.895   | 1.563        | 0.647        | ---          | 0.907        | 1.554             |
| 09/18/24   | 0.826   | ---     | 0.989   | 1.815        | 0.746        | ---          | 1.045        | 1.790             |
| 09/19/24   | 0.719   | ---     | 1.064   | 1.783        | 0.654        | ---          | 0.976        | 1.630             |
| 09/20/24   | 0.762   | ---     | 0.911   | 1.673        | 0.719        | ---          | 0.938        | 1.657             |
| 09/21/24   | 0.742   | ---     | 1.195   | 1.937        | 0.681        | ---          | 1.192        | 1.874             |
| 09/22/24   | 0.857   | ---     | 1.040   | 1.897        | 0.799        | ---          | 1.000        | 1.798             |
| 09/23/24   | 0.666   | ---     | 0.906   | 1.573        | 0.590        | ---          | 0.914        | 1.504             |
| 09/24/24   | 0.708   | ---     | 0.977   | 1.685        | 0.678        | ---          | 0.989        | 1.667             |
| 09/25/24   | 0.836   | ---     | 1.052   | 1.888        | 0.780        | ---          | 1.020        | 1.800             |
| 09/26/24   | 0.825   | ---     | 0.960   | 1.785        | 0.737        | ---          | 0.926        | 1.663             |
| 09/27/24   | 0.646   | ---     | 0.944   | 1.590        | 0.614        | ---          | 0.967        | 1.582             |
| 09/28/24   | 0.741   | ---     | 1.150   | 1.891        | 0.705        | ---          | 1.174        | 1.880             |
| 09/29/24   | 0.836   | ---     | 1.168   | 2.003        | 0.751        | ---          | 1.140        | 1.890             |
| 09/30/24   | 0.789   | ---     | 0.885   | 1.674        | 0.716        | ---          | 0.832        | 1.548             |
| Total (MG) | 21.205  | 0.000   | 28.396  | 49.601       | 19.761       | 0.000        | 28.103       | 47.864            |
| Highest    | 0.857   | ---     | 1.195   | 2.003        | 0.799        | ---          | 1.192        | 1.890             |
| Average    | 0.707   | 0.000   | 0.947   | 1.653        | 0.659        | 0.000        | 0.937        | 1.595             |
| Lowest     | 0.468   | ---     | 0.725   | 1.216        | 0.473        | ---          | 0.753        | 1.231             |


September 2024

## Water Plant 1 Water Production

This Month

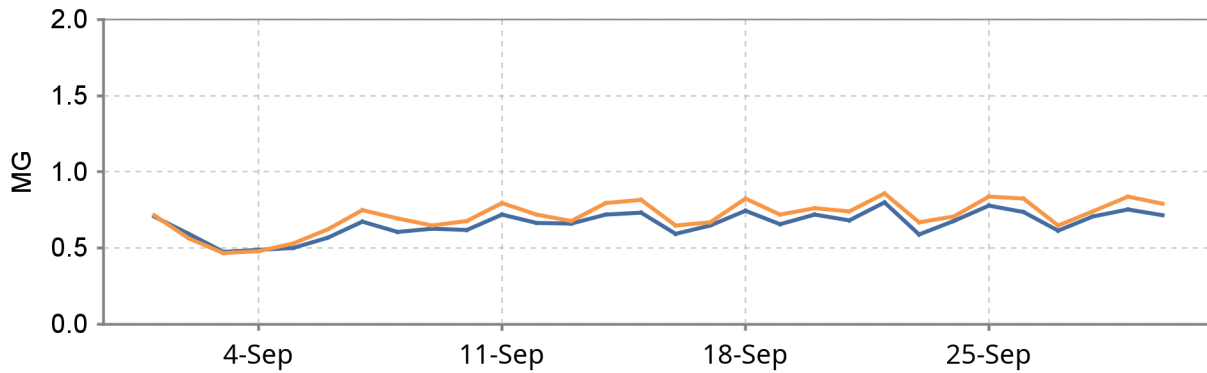


| Date       | WP1 Raw | WP1 Clarifier A | WP1 Clarifier B | WP1 Finished | WP1 Process Loss | WP1 Efficiency |
|------------|---------|-----------------|-----------------|--------------|------------------|----------------|
| 09/01/24   | 0.714   | 0.367           | 0.367           | 0.706        | 0.008            | 99%            |
| 09/02/24   | 0.563   | 0.275           | 0.275           | 0.592        | -0.029           | 105%           |
| 09/03/24   | 0.468   | 0.234           | 0.234           | 0.473        | -0.005           | 101%           |
| 09/04/24   | 0.479   | 0.235           | 0.235           | 0.486        | -0.007           | 101%           |
| 09/05/24   | 0.530   | 0.265           | 0.265           | 0.501        | 0.029            | 94%            |
| 09/06/24   | 0.620   | 0.339           | 0.285           | 0.568        | 0.052            | 92%            |
| 09/07/24   | 0.748   | 0.421           | 0.326           | 0.671        | 0.076            | 90%            |
| 09/08/24   | 0.694   | 0.380           | 0.305           | 0.606        | 0.089            | 87%            |
| 09/09/24   | 0.647   | 0.369           | 0.282           | 0.628        | 0.020            | 97%            |
| 09/10/24   | 0.678   | 0.389           | 0.294           | 0.618        | 0.059            | 91%            |
| 09/11/24   | 0.795   | 0.452           | 0.346           | 0.718        | 0.076            | 90%            |
| 09/12/24   | 0.718   | 0.401           | 0.305           | 0.665        | 0.053            | 93%            |
| 09/13/24   | 0.677   | 0.392           | 0.294           | 0.662        | 0.015            | 98%            |
| 09/14/24   | 0.793   | 0.440           | 0.356           | 0.721        | 0.073            | 91%            |
| 09/15/24   | 0.815   | 0.465           | 0.345           | 0.733        | 0.082            | 90%            |
| 09/16/24   | 0.646   | 0.361           | 0.275           | 0.594        | 0.051            | 92%            |
| 09/17/24   | 0.667   | 0.381           | 0.295           | 0.647        | 0.020            | 97%            |
| 09/18/24   | 0.826   | 0.464           | 0.355           | 0.746        | 0.080            | 90%            |
| 09/19/24   | 0.719   | 0.413           | 0.316           | 0.654        | 0.065            | 91%            |
| 09/20/24   | 0.762   | 0.434           | 0.335           | 0.719        | 0.042            | 94%            |
| 09/21/24   | 0.742   | 0.412           | 0.314           | 0.681        | 0.061            | 92%            |
| 09/22/24   | 0.857   | 0.494           | 0.378           | 0.799        | 0.058            | 93%            |
| 09/23/24   | 0.666   | 0.370           | 0.286           | 0.590        | 0.076            | 89%            |
| 09/24/24   | 0.708   | 0.404           | 0.306           | 0.678        | 0.030            | 96%            |
| 09/25/24   | 0.836   | 0.476           | 0.357           | 0.780        | 0.056            | 93%            |
| 09/26/24   | 0.825   | 0.463           | 0.367           | 0.737        | 0.088            | 89%            |
| 09/27/24   | 0.646   | 0.371           | 0.276           | 0.614        | 0.031            | 95%            |
| 09/28/24   | 0.741   | 0.414           | 0.315           | 0.705        | 0.036            | 95%            |
| 09/29/24   | 0.836   | 0.474           | 0.367           | 0.751        | 0.085            | 90%            |
| 09/30/24   | 0.789   | 0.450           | 0.344           | 0.716        | 0.073            | 91%            |
| Total (MG) | 21.205  | 11.803          | 9.402           | 19.761       | 1.444            | -              |
| Highest    | 0.857   | 0.494           | 0.378           | 0.799        | -                | -              |
| Average    | 0.707   | 0.393           | 0.313           | 0.659        | -                | 93%            |
| Lowest     | 0.468   | 0.234           | 0.234           | 0.473        | -                | -              |

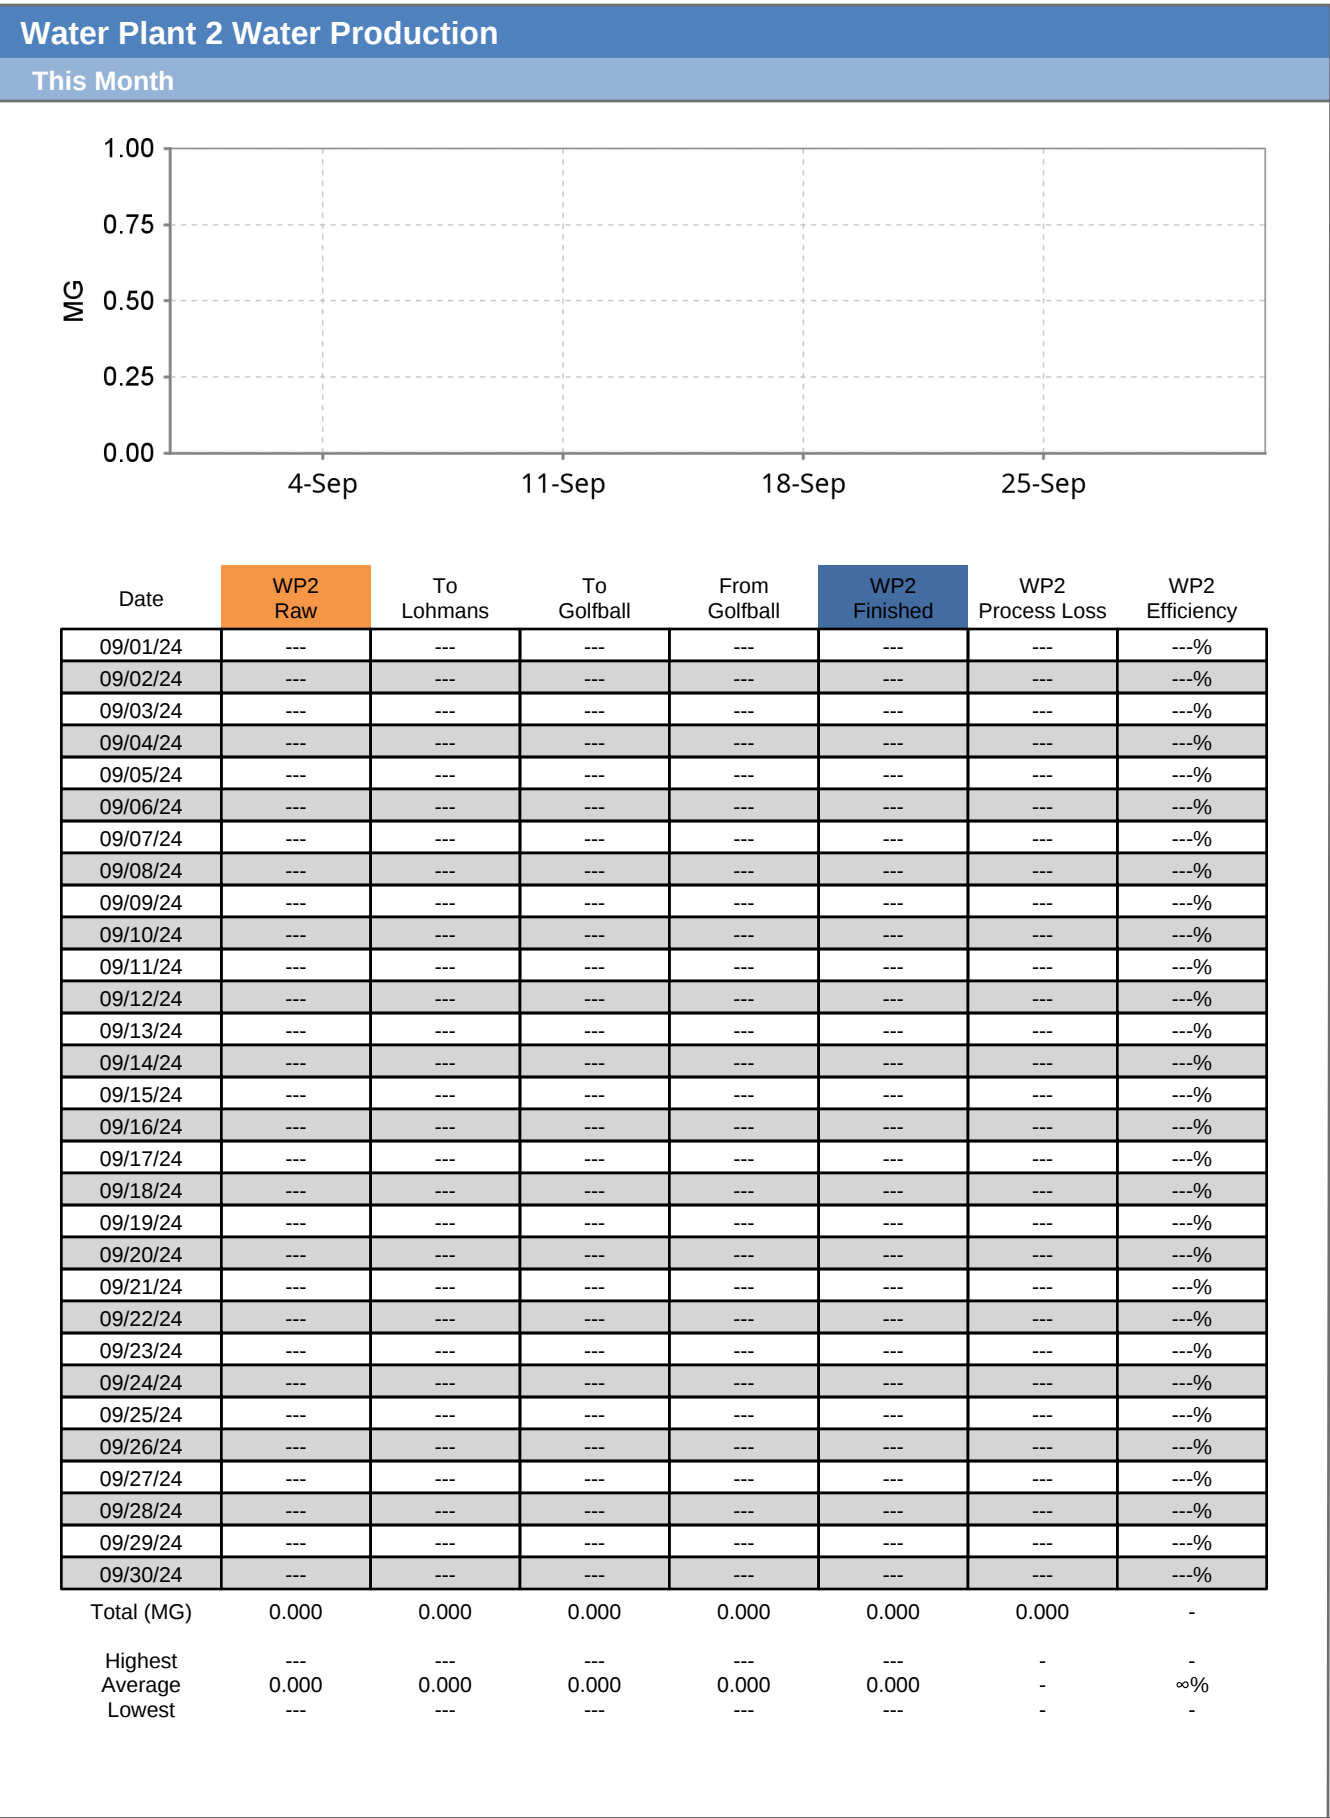

September 2024

## Water Plant 3 Water Production

This Month

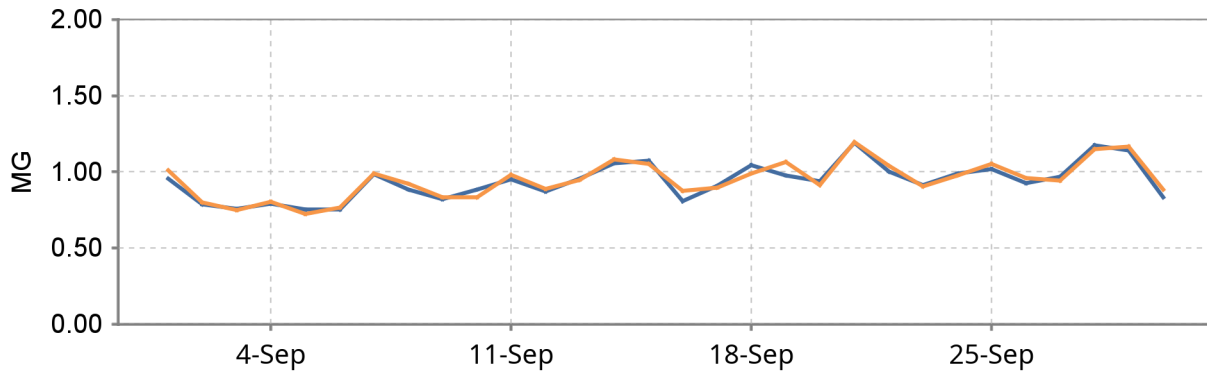


| Date       | WP3 Raw | WP3 Unit 1 | WP3 Decant | WP3 Backwash | WP3 Finished | WP3 Process Loss | WP3 Efficiency |
|------------|---------|------------|------------|--------------|--------------|------------------|----------------|
| 09/01/24   | 1.011   | 1.088      | 0.000      | 0.053        | 0.955        | 0.056            | 94%            |
| 09/02/24   | 0.800   | 0.788      | 0.000      | 0.002        | 0.788        | 0.012            | 99%            |
| 09/03/24   | 0.748   | 0.764      | 0.000      | 0.000        | 0.758        | -0.009           | 101%           |
| 09/04/24   | 0.804   | 0.888      | 0.000      | 0.048        | 0.789        | 0.016            | 98%            |
| 09/05/24   | 0.725   | 0.726      | 0.000      | 0.007        | 0.753        | -0.028           | 104%           |
| 09/06/24   | 0.765   | 0.769      | 0.000      | 0.000        | 0.755        | 0.010            | 99%            |
| 09/07/24   | 0.989   | 1.030      | 0.000      | 0.052        | 0.985        | 0.004            | 100%           |
| 09/08/24   | 0.922   | 0.936      | 0.000      | 0.003        | 0.883        | 0.039            | 96%            |
| 09/09/24   | 0.834   | 0.829      | 0.000      | 0.000        | 0.820        | 0.014            | 98%            |
| 09/10/24   | 0.833   | 0.887      | 0.000      | 0.050        | 0.881        | -0.048           | 106%           |
| 09/11/24   | 0.979   | 1.004      | 0.000      | 0.005        | 0.951        | 0.028            | 97%            |
| 09/12/24   | 0.886   | 0.884      | 0.000      | 0.000        | 0.871        | 0.015            | 98%            |
| 09/13/24   | 0.949   | 1.021      | 0.000      | 0.047        | 0.955        | -0.007           | 101%           |
| 09/14/24   | 1.083   | 1.073      | 0.000      | 0.008        | 1.058        | 0.025            | 98%            |
| 09/15/24   | 1.054   | 1.067      | 0.000      | 0.000        | 1.071        | -0.018           | 102%           |
| 09/16/24   | 0.876   | 0.925      | 0.000      | 0.055        | 0.809        | 0.067            | 92%            |
| 09/17/24   | 0.895   | 0.918      | 0.000      | 0.000        | 0.907        | -0.012           | 101%           |
| 09/18/24   | 0.989   | 0.999      | 0.000      | 0.052        | 1.045        | -0.056           | 106%           |
| 09/19/24   | 1.064   | 1.115      | 0.000      | 0.003        | 0.976        | 0.088            | 92%            |
| 09/20/24   | 0.911   | 0.914      | 0.000      | 0.000        | 0.938        | -0.027           | 103%           |
| 09/21/24   | 1.195   | 1.264      | 0.000      | 0.050        | 1.192        | 0.003            | 100%           |
| 09/22/24   | 1.040   | 1.039      | 0.000      | 0.005        | 1.000        | 0.040            | 96%            |
| 09/23/24   | 0.906   | 0.912      | 0.000      | 0.000        | 0.914        | -0.008           | 101%           |
| 09/24/24   | 0.977   | 1.033      | 0.000      | 0.054        | 0.989        | -0.012           | 101%           |
| 09/25/24   | 1.052   | 1.060      | 0.000      | 0.001        | 1.020        | 0.032            | 97%            |
| 09/26/24   | 0.960   | 1.020      | 0.000      | 0.051        | 0.926        | 0.034            | 96%            |
| 09/27/24   | 0.944   | 0.958      | 0.000      | 0.004        | 0.967        | -0.023           | 102%           |
| 09/28/24   | 1.150   | 1.163      | 0.000      | 0.000        | 1.174        | -0.025           | 102%           |
| 09/29/24   | 1.168   | 1.221      | 0.000      | 0.048        | 1.140        | 0.028            | 98%            |
| 09/30/24   | 0.885   | 0.883      | 0.000      | 0.007        | 0.832        | 0.053            | 94%            |
| Total (MG) | 28.396  | 29.176     | 0.000      | 0.605        | 28.103       | 0.293            | -              |
| Highest    | 1.195   | 1.264      | 0.000      | 0.055        | 1.192        | -                | -              |
| Average    | 0.947   | 0.973      | 0.000      | 0.020        | 0.937        | -                | 99%            |
| Lowest     | 0.725   | 0.726      | 0.000      | 0.000        | 0.753        | -                | -              |

September 2024

## Waste Water Treatment

This Month

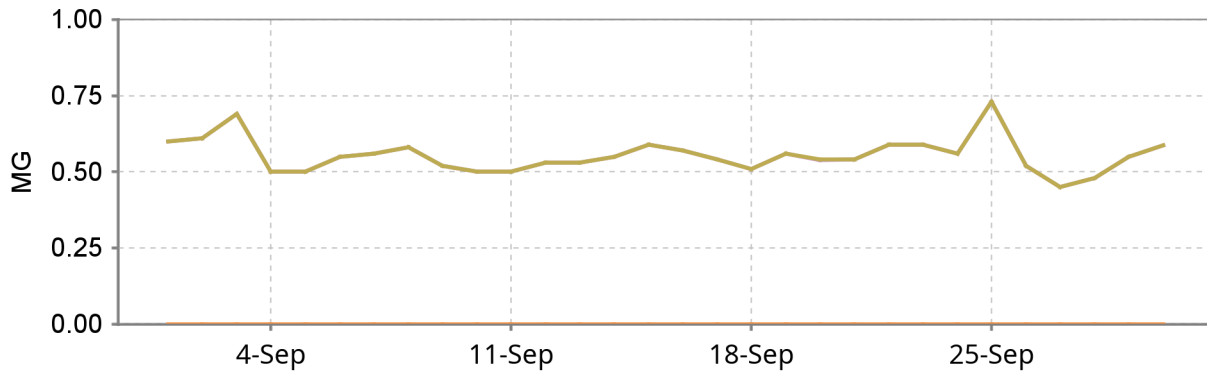


| Date       | WWTP Treated | LVGC Permit | Cedar Breaks Permit | WWTP Permit | Reclaimed Effluent 210A Permit |
|------------|--------------|-------------|---------------------|-------------|--------------------------------|
| 09/01/24   | 0.600        | 0.081       | 0.000               | 0.600       | 0.000                          |
| 09/02/24   | 0.610        | 0.081       | 0.000               | 0.610       | 0.000                          |
| 09/03/24   | 0.690        | 0.153       | 0.000               | 0.690       | 0.000                          |
| 09/04/24   | 0.500        | 0.060       | 0.000               | 0.500       | 0.000                          |
| 09/05/24   | 0.500        | 0.081       | 0.000               | 0.500       | 0.000                          |
| 09/06/24   | 0.550        | 0.183       | 0.000               | 0.550       | 0.000                          |
| 09/07/24   | 0.560        | 0.091       | 0.000               | 0.560       | 0.000                          |
| 09/08/24   | 0.580        | 0.111       | 0.000               | 0.580       | 0.000                          |
| 09/09/24   | 0.520        | 0.101       | 0.000               | 0.520       | 0.000                          |
| 09/10/24   | 0.500        | 0.134       | 0.000               | 0.500       | 0.000                          |
| 09/11/24   | 0.500        | 0.183       | 0.000               | 0.500       | 0.000                          |
| 09/12/24   | 0.530        | 0.082       | 0.000               | 0.530       | 0.000                          |
| 09/13/24   | 0.530        | 0.132       | 0.000               | 0.530       | 0.000                          |
| 09/14/24   | 0.550        | 0.081       | 0.000               | 0.550       | 0.000                          |
| 09/15/24   | 0.590        | 0.153       | 0.000               | 0.590       | 0.000                          |
| 09/16/24   | 0.570        | 0.154       | 0.000               | 0.570       | 0.000                          |
| 09/17/24   | 0.540        | 0.122       | 0.000               | 0.540       | 0.000                          |
| 09/18/24   | 0.510        | 0.142       | 0.000               | 0.510       | 0.000                          |
| 09/19/24   | 0.560        | 0.194       | 0.344               | 0.560       | 0.000                          |
| 09/20/24   | 0.540        | 0.204       | 0.505               | 0.539       | 0.000                          |
| 09/21/24   | 0.540        | 0.193       | 0.445               | 0.540       | 0.000                          |
| 09/22/24   | 0.590        | 0.214       | 0.491               | 0.590       | 0.000                          |
| 09/23/24   | 0.590        | 0.244       | 0.456               | 0.590       | 0.000                          |
| 09/24/24   | 0.560        | 0.192       | 0.570               | 0.560       | 0.000                          |
| 09/25/24   | 0.730        | 0.185       | 0.688               | 0.730       | 0.000                          |
| 09/26/24   | 0.520        | 0.142       | 0.063               | 0.520       | 0.000                          |
| 09/27/24   | 0.450        | 0.224       | 0.001               | 0.450       | 0.000                          |
| 09/28/24   | 0.480        | 0.194       | 0.000               | 0.480       | 0.000                          |
| 09/29/24   | 0.550        | 0.162       | 0.000               | 0.550       | 0.000                          |
| 09/30/24   | 0.587        | 0.359       | 0.799               | 0.588       | 0.000                          |
| Total (MG) | 16.627       | 4.633       | 4.363               | 16.627      | 0.000                          |
| Highest    | 0.730        | 0.359       | 0.799               | 0.730       | 0.000                          |
| Average    | 0.554        | 0.154       | 0.145               | 0.554       | 0.000                          |
| Lowest     | 0.450        | 0.060       | 0.000               | 0.450       | 0.000                          |

September 2024

## Effluent Disposal


This Month

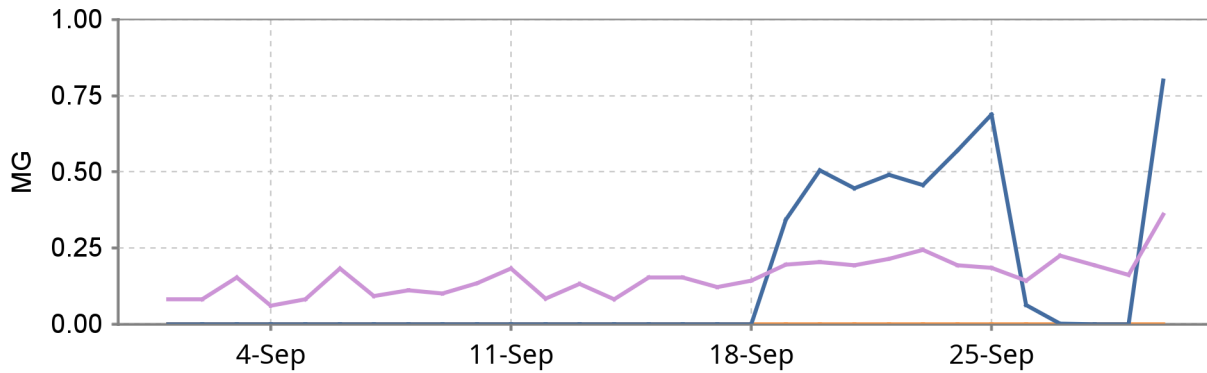

| Date       | LVGC Usage | LVGC Permit | Cedar Brks. Usage | Cedar Brks. Permit | HLGC Usage | Reclaimed E 210A Permit | LVGC Lake Water | HLGC Lake Water |
|------------|------------|-------------|-------------------|--------------------|------------|-------------------------|-----------------|-----------------|
| 09/01/24   | 0.081      | 0.081       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/02/24   | 0.081      | 0.081       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/03/24   | 0.153      | 0.153       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/04/24   | 0.060      | 0.060       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/05/24   | 0.081      | 0.081       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/06/24   | 0.183      | 0.183       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/07/24   | 0.091      | 0.091       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/08/24   | 0.111      | 0.111       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/09/24   | 0.101      | 0.101       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/10/24   | 0.134      | 0.134       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/11/24   | 0.183      | 0.183       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/12/24   | 0.082      | 0.082       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/13/24   | 0.132      | 0.132       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/14/24   | 0.081      | 0.081       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/15/24   | 0.153      | 0.153       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/16/24   | 0.154      | 0.154       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/17/24   | 0.122      | 0.122       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/18/24   | 0.142      | 0.142       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/19/24   | 0.194      | 0.194       | 0.344             | 0.344              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/20/24   | 0.204      | 0.204       | 0.505             | 0.505              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/21/24   | 0.193      | 0.193       | 0.445             | 0.445              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/22/24   | 0.214      | 0.214       | 0.491             | 0.491              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/23/24   | 0.244      | 0.244       | 0.456             | 0.456              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/24/24   | 0.192      | 0.192       | 0.570             | 0.570              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/25/24   | 0.185      | 0.185       | 0.688             | 0.688              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/26/24   | 0.142      | 0.142       | 0.063             | 0.063              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/27/24   | 0.224      | 0.224       | 0.001             | 0.001              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/28/24   | 0.194      | 0.194       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/29/24   | 0.162      | 0.162       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| 09/30/24   | 0.359      | 0.359       | 0.799             | 0.799              | 0.000      | 0.000                   | 0.000           | ---             |
| Total (MG) | 4.633      | 4.633       | 4.363             | 4.363              | 0.000      | 0.000                   | 0.000           | 0.000           |
| Highest    | 0.359      | 0.359       | 0.799             | 0.799              | 0.000      | 0.000                   | 0.000           | ---             |
| Average    | 0.154      | 0.154       | 0.145             | 0.145              | 0.000      | 0.000                   | 0.000           | 0.000           |
| Lowest     | 0.060      | 0.060       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |

Combined Water Production


Past 12 Months

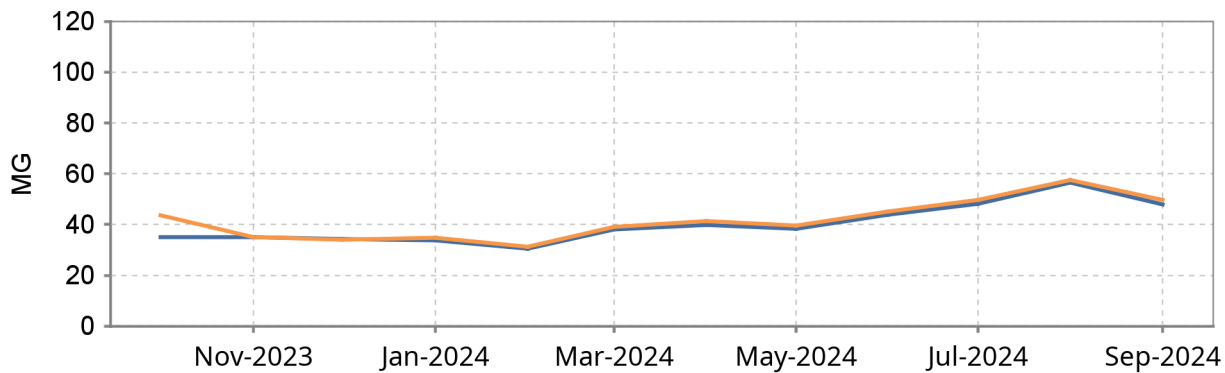

| Date       | WP1 Raw | WP2 Raw | WP3 Raw | Combined Raw | WP1 Finished | WP2 Finished | WP3 Finished | Combined Finished |
|------------|---------|---------|---------|--------------|--------------|--------------|--------------|-------------------|
| Oct, 2023  | 16.560  | ---     | 27.064  | 43.624       | 8.364        | ---          | 26.753       | 35.117            |
| Nov, 2023  | 13.214  | ---     | 21.813  | 35.028       | 13.461       | ---          | 21.505       | 34.965            |
| Dec, 2023  | 12.536  | ---     | 21.446  | 33.981       | 13.026       | ---          | 21.281       | 34.307            |
| Jan, 2024  | 11.078  | ---     | 23.843  | 34.920       | 10.521       | ---          | 23.336       | 33.857            |
| Feb, 2024  | 6.493   | ---     | 24.883  | 31.376       | 5.973        | ---          | 24.546       | 30.519            |
| Mar, 2024  | 9.271   | ---     | 29.837  | 39.108       | 8.548        | ---          | 29.469       | 38.017            |
| Apr, 2024  | 11.258  | ---     | 30.009  | 41.267       | 10.391       | ---          | 29.535       | 39.926            |
| May, 2024  | 11.888  | ---     | 27.620  | 39.509       | 10.941       | ---          | 27.285       | 38.226            |
| Jun, 2024  | 17.020  | ---     | 28.194  | 45.214       | 15.963       | ---          | 27.872       | 43.835            |
| Jul, 2024  | 18.856  | ---     | 30.889  | 49.745       | 17.765       | ---          | 30.557       | 48.322            |
| Aug, 2024  | 21.790  | ---     | 35.757  | 57.547       | 21.129       | ---          | 35.392       | 56.521            |
| Sep, 2024  | 21.205  | ---     | 28.396  | 49.601       | 19.761       | ---          | 28.103       | 47.864            |
| Total (MG) | 171.169 | 0.000   | 329.751 | 500.919      | 155.843      | 0.000        | 325.635      | 481.478           |
| Highest    | 21.790  | ---     | 35.757  | 57.547       | 21.129       | ---          | 35.392       | 56.521            |
| Average    | 14.264  | 0.000   | 27.479  | 41.743       | 12.987       | 0.000        | 27.136       | 40.123            |
| Lowest     | 6.493   | ---     | 21.446  | 31.376       | 5.973        | ---          | 21.281       | 30.519            |

Water Plant 1 Water Production


Past 12 Months

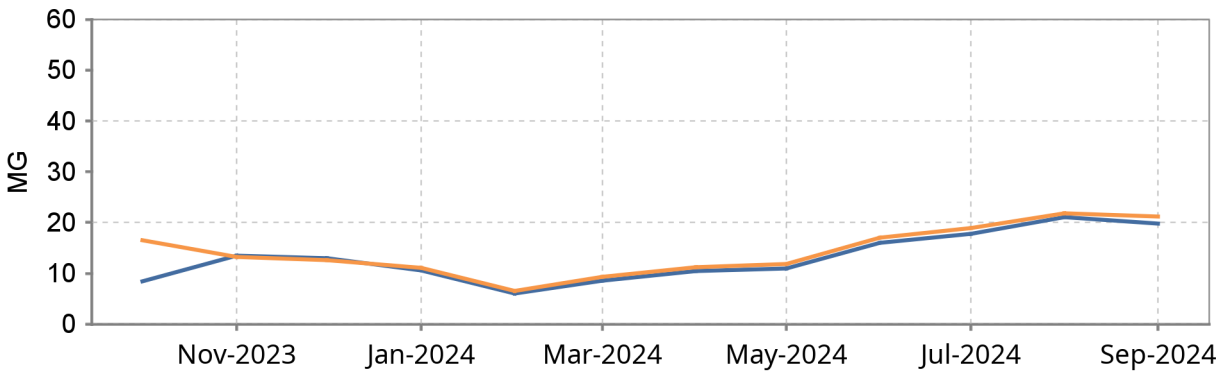

| Date       | WP1 Raw | WP1 Clarifier A | WP1 Clarifier B | WP1 Finished | WP1 Process Loss | WP1 Efficiency |
|------------|---------|-----------------|-----------------|--------------|------------------|----------------|
| Oct, 2023  | 16.560  | 10.276          | 6.279           | 8.364        | 8.196            | 51%            |
| Nov, 2023  | 13.214  | 8.216           | 4.996           | 13.461       | -0.246           | 102%           |
| Dec, 2023  | 12.536  | 7.773           | 4.763           | 13.026       | -0.490           | 104%           |
| Jan, 2024  | 11.078  | 6.779           | 4.289           | 10.521       | 0.557            | 95%            |
| Feb, 2024  | 6.493   | 4.027           | 2.476           | 5.973        | 0.519            | 92%            |
| Mar, 2024  | 9.271   | 5.707           | 3.560           | 8.548        | 0.723            | 92%            |
| Apr, 2024  | 11.258  | 6.728           | 4.536           | 10.391       | 0.867            | 92%            |
| May, 2024  | 11.888  | 7.086           | 4.774           | 10.941       | 0.947            | 92%            |
| Jun, 2024  | 17.020  | 10.271          | 6.757           | 15.963       | 1.057            | 94%            |
| Jul, 2024  | 18.856  | 11.355          | 7.502           | 17.765       | 1.092            | 94%            |
| Aug, 2024  | 21.790  | 11.931          | 9.852           | 21.129       | 0.660            | 97%            |
| Sep, 2024  | 21.205  | 11.803          | 9.402           | 19.761       | 1.444            | 93%            |
| Total (MG) | 171.169 | 101.954         | 69.188          | 155.843      | 15.326           | -              |
| Highest    | 21.790  | 11.931          | 9.852           | 21.129       | -                | -              |
| Average    | 14.264  | 8.496           | 5.766           | 12.987       | -                | 91%            |
| Lowest     | 6.493   | 4.027           | 2.476           | 5.973        | -                | -              |

Water Plant 2 Water Production


Past 12 Months

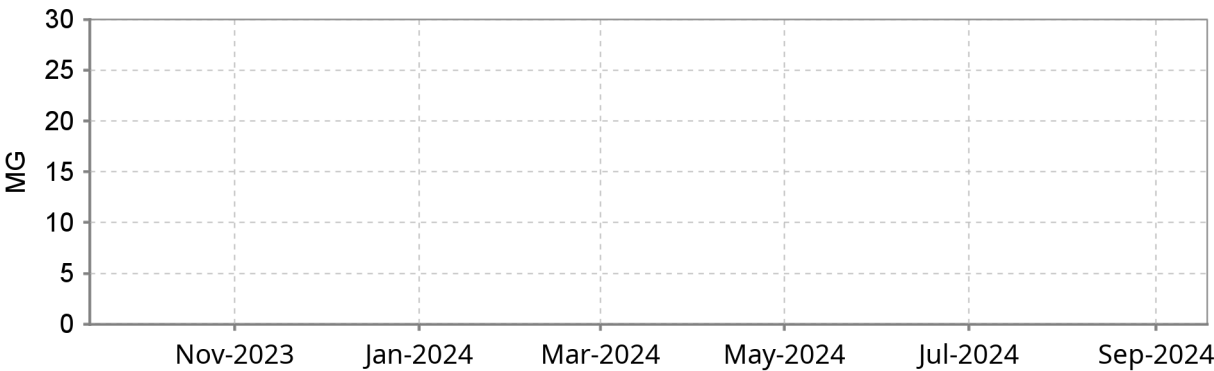

| Date       | WP2 Raw | To Lohmans | To Golfball | From Golfball | WP2 Finished | WP2 Process Loss | WP2 Efficiency |
|------------|---------|------------|-------------|---------------|--------------|------------------|----------------|
| Oct, 2023  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Nov, 2023  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Dec, 2023  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Jan, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Feb, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Mar, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Apr, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| May, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Jun, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Jul, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Aug, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Sep, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Total (MG) | 0.000   | 0.000      | 0.000       | 0.000         | 0.000        | 0.000            | -              |
| Highest    | ---     | ---        | ---         | ---           | ---          | -                | -              |
| Average    | 0.000   | 0.000      | 0.000       | 0.000         | 0.000        | -                | ∞%             |
| Lowest     | ---     | ---        | ---         | ---           | ---          | -                | -              |

Water Plant 3 Water Production


Past 12 Months

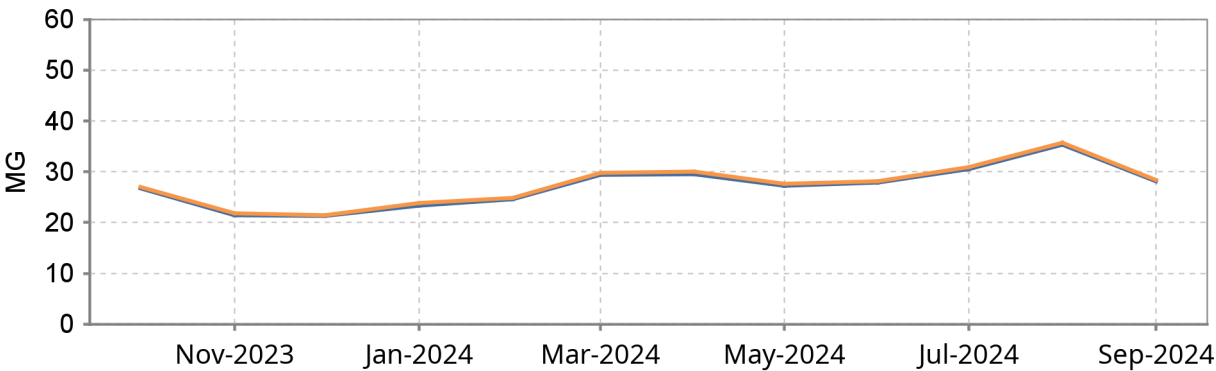

| Date       | WP3 Raw | WP3 Unit 1 | WP3 Decant | WP3 Backwash | WP3 Finished | WP3 Process Loss | WP3 Efficiency |
|------------|---------|------------|------------|--------------|--------------|------------------|----------------|
| Oct, 2023  | 27.064  | 27.791     | 0.000      | 0.442        | 26.753       | 0.312            | 99%            |
| Nov, 2023  | 21.813  | 22.364     | 0.000      | 0.381        | 21.505       | 0.309            | 99%            |
| Dec, 2023  | 21.446  | 21.996     | 0.000      | 0.382        | 21.281       | 0.164            | 99%            |
| Jan, 2024  | 23.843  | 24.246     | 0.000      | 0.380        | 23.336       | 0.507            | 98%            |
| Feb, 2024  | 24.883  | 25.527     | 0.000      | 0.440        | 24.546       | 0.337            | 99%            |
| Mar, 2024  | 29.837  | 30.560     | 0.000      | 0.495        | 29.469       | 0.368            | 99%            |
| Apr, 2024  | 30.009  | 30.600     | 0.000      | 0.494        | 29.535       | 0.474            | 98%            |
| May, 2024  | 27.620  | 28.178     | 0.000      | 0.440        | 27.285       | 0.335            | 99%            |
| Jun, 2024  | 28.194  | 28.739     | 0.000      | 0.495        | 27.872       | 0.322            | 99%            |
| Jul, 2024  | 30.889  | 31.464     | 0.000      | 0.495        | 30.557       | 0.331            | 99%            |
| Aug, 2024  | 35.757  | 36.729     | 0.000      | 0.768        | 35.392       | 0.365            | 99%            |
| Sep, 2024  | 28.396  | 29.176     | 0.000      | 0.605        | 28.103       | 0.293            | 99%            |
| Total (MG) | 329.751 | 337.371    | 0.000      | 5.818        | 325.635      | 4.116            | -              |
| Highest    | 35.757  | 36.729     | 0.000      | 0.768        | 35.392       | -                | -              |
| Average    | 27.479  | 28.114     | 0.000      | 0.485        | 27.136       | -                | 99%            |
| Lowest     | 21.446  | 21.996     | 0.000      | 0.380        | 21.281       | -                | -              |

Waste Water Treatment


Past 12 Months

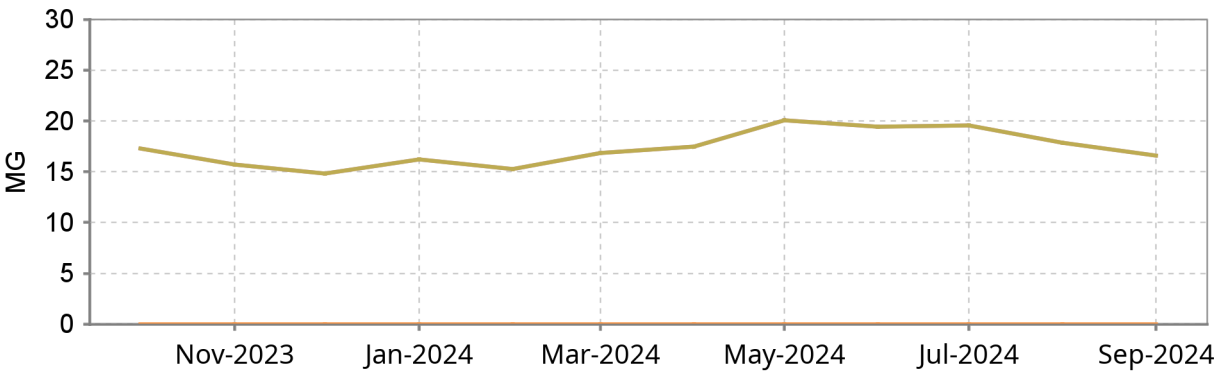

| Date       | WWTP Treated | LVGC Permit | Cedar Breaks Permit | WWTP Permit | Reclaimed Effluent 210A Permit |
|------------|--------------|-------------|---------------------|-------------|--------------------------------|
| Oct, 2023  | 17.270       | 6.956       | 0.000               | 17.270      | 0.000                          |
| Nov, 2023  | 15.690       | 5.511       | 30.378              | 15.690      | 0.000                          |
| Dec, 2023  | 14.823       | 5.239       | -30.378             | 14.823      | 0.000                          |
| Jan, 2024  | 16.217       | 2.082       | 30.378              | 16.217      | 0.000                          |
| Feb, 2024  | 15.299       | 0.000       | 0.000               | 15.299      | 0.000                          |
| Mar, 2024  | 16.836       | 0.000       | 0.000               | 16.836      | 0.000                          |
| Apr, 2024  | 17.490       | 3.467       | 12.976              | 17.490      | 0.000                          |
| May, 2024  | 20.104       | 4.413       | 3.674               | 20.104      | 0.000                          |
| Jun, 2024  | 19.447       | 5.109       | 0.000               | 19.447      | 0.000                          |
| Jul, 2024  | 19.570       | 4.772       | 0.000               | 19.570      | 0.000                          |
| Aug, 2024  | 17.850       | 5.993       | 0.000               | 17.850      | 0.000                          |
| Sep, 2024  | 16.627       | 4.633       | 4.363               | 16.627      | 0.000                          |
| Total (MG) | 207.223      | 48.175      | 51.390              | 207.223     | 0.000                          |
| Highest    | 20.104       | 6.956       | 30.378              | 20.104      | 0.000                          |
| Average    | 17.269       | 4.015       | 4.282               | 17.269      | 0.000                          |
| Lowest     | 14.823       | 0.000       | -30.378             | 14.823      | 0.000                          |

Effluent Disposal


Past 12 Months

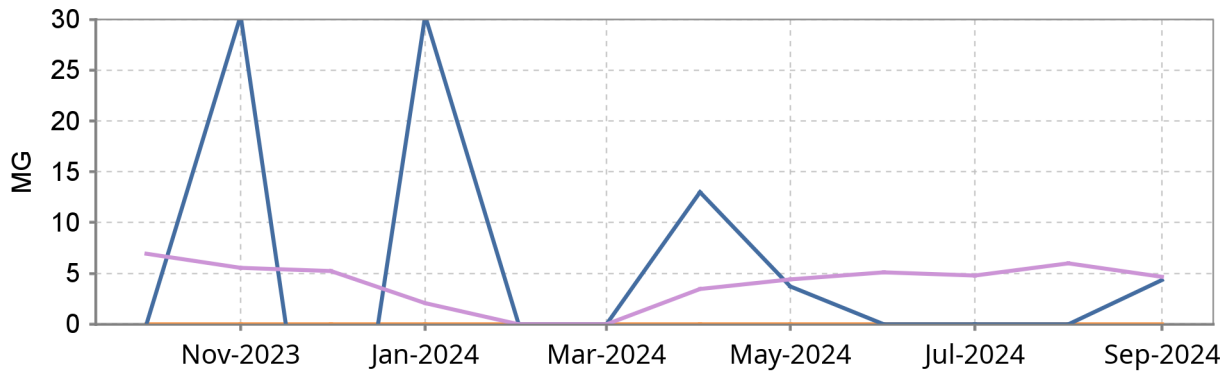

| Date       | LVGC Usage | LVGC Permit | Cedar Brks. Usage | Cedar Brks. Permit | HLGC Usage | Reclaimed E 210A Permit | LVGC Lake Water | HLGC Lake Water |
|------------|------------|-------------|-------------------|--------------------|------------|-------------------------|-----------------|-----------------|
| Oct, 2023  | 6.956      | 6.956       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Nov, 2023  | 5.511      | 5.511       | 30.378            | 30.378             | 0.000      | 0.000                   | 0.000           | ---             |
| Dec, 2023  | 5.239      | 5.239       | -30.378           | -30.378            | 0.000      | 0.000                   | 0.000           | ---             |
| Jan, 2024  | 2.082      | 2.082       | 30.378            | 30.378             | 0.000      | 0.000                   | 0.000           | ---             |
| Feb, 2024  | 0.000      | 0.000       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Mar, 2024  | 0.000      | 0.000       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Apr, 2024  | 3.467      | 3.467       | 12.981            | 12.976             | 0.000      | 0.000                   | 0.000           | ---             |
| May, 2024  | 4.413      | 4.413       | 3.674             | 3.674              | 0.000      | 0.000                   | 0.000           | ---             |
| Jun, 2024  | 5.109      | 5.109       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Jul, 2024  | 4.772      | 4.772       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Aug, 2024  | 5.993      | 5.993       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Sep, 2024  | 4.633      | 4.633       | 4.363             | 4.363              | 0.000      | 0.000                   | 0.000           | ---             |
| Total (MG) | 48.175     | 48.175      | 51.396            | 51.390             | 0.000      | 0.000                   | 0.000           | 0.000           |
| Highest    | 6.956      | 6.956       | 30.378            | 30.378             | 0.000      | 0.000                   | 0.000           | ---             |
| Average    | 4.015      | 4.015       | 4.283             | 4.282              | 0.000      | 0.000                   | 0.000           | 0.000           |
| Lowest     | 0.000      | 0.000       | -30.378           | -30.378            | 0.000      | 0.000                   | 0.000           | ---             |

Combined Water Production


5 Year Average Daily Production

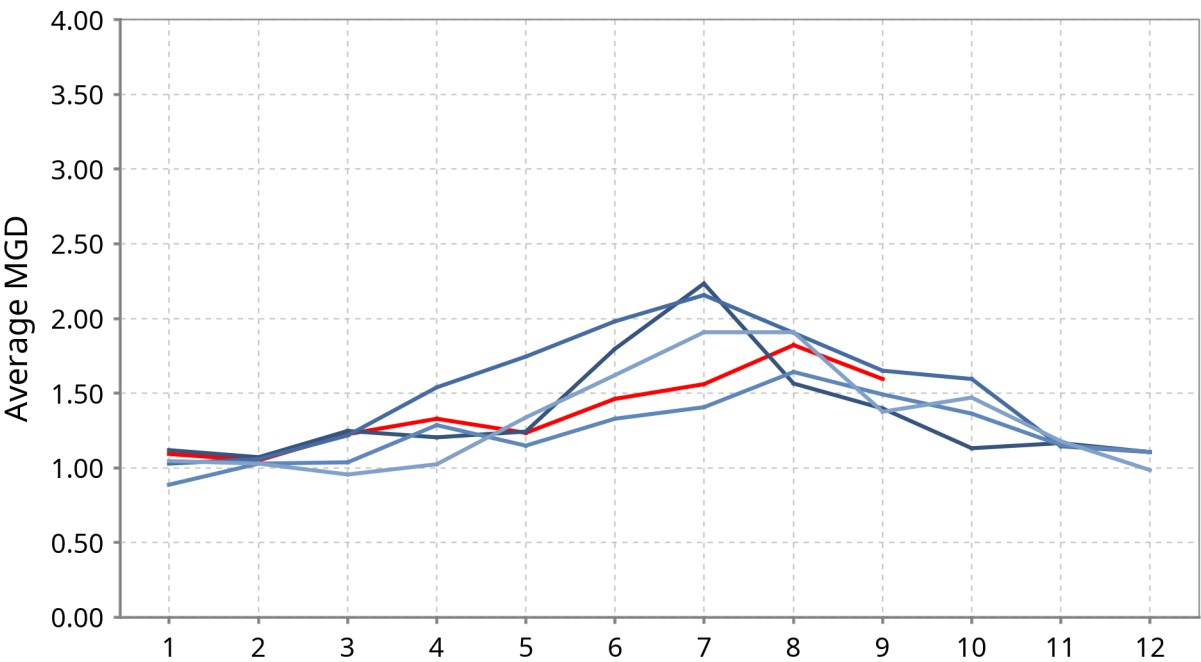

| Month   | Year - 4 | Year - 3 | Year - 2 | Last Year | This Year |
|---------|----------|----------|----------|-----------|-----------|
| Jan     | 1.047    | 0.888    | 1.027    | 1.118     | 1.092     |
| Feb     | 1.031    | 1.030    | 1.059    | 1.073     | 1.052     |
| Mar     | 0.957    | 1.039    | 1.217    | 1.246     | 1.226     |
| Apr     | 1.023    | 1.285    | 1.541    | 1.205     | 1.331     |
| May     | 1.339    | 1.149    | 1.744    | 1.243     | 1.233     |
| Jun     | 1.621    | 1.330    | 1.982    | 1.796     | 1.461     |
| Jul     | 1.906    | 1.407    | 2.158    | 2.233     | 1.559     |
| Aug     | 1.909    | 1.642    | 1.905    | 1.563     | 1.823     |
| Sep     | 1.376    | 1.492    | 1.652    | 1.400     | 1.595     |
| Oct     | 1.469    | 1.365    | 1.594    | 1.133     | ---       |
| Nov     | 1.178    | 1.153    | 1.144    | 1.166     | ---       |
| Dec     | 0.985    | 1.105    | 1.108    | 1.107     | ---       |
| Highest | 1.909    | 1.642    | 2.158    | 2.233     | 1.823     |
| Average | 1.320    | 1.240    | 1.511    | 1.357     | 1.375     |
| Lowest  | 0.957    | 0.888    | 1.027    | 1.073     | 1.052     |

Waste Water Treatment

5 Year Average Daily Treated

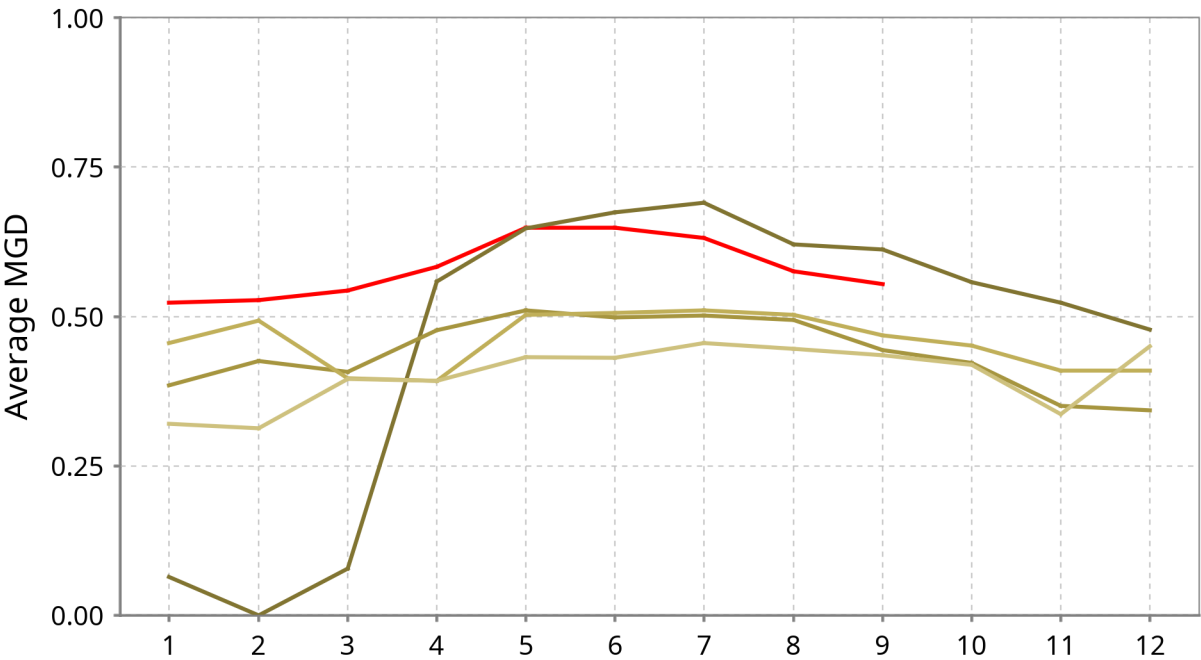

| Month   | Year - 4 | Year - 3 | Year - 2 | Last Year | This Year |
|---------|----------|----------|----------|-----------|-----------|
| Jan     | 0.320    | 0.456    | 0.385    | 0.064     | 0.523     |
| Feb     | 0.313    | 0.493    | 0.425    | 0.000     | 0.528     |
| Mar     | 0.396    | 0.396    | 0.407    | 0.078     | 0.543     |
| Apr     | 0.392    | 0.392    | 0.477    | 0.559     | 0.583     |
| May     | 0.431    | 0.503    | 0.511    | 0.648     | 0.649     |
| Jun     | 0.431    | 0.506    | 0.499    | 0.675     | 0.648     |
| Jul     | 0.455    | 0.510    | 0.502    | 0.690     | 0.631     |
| Aug     | 0.446    | 0.503    | 0.494    | 0.620     | 0.576     |
| Sep     | 0.435    | 0.469    | 0.443    | 0.612     | 0.554     |
| Oct     | 0.419    | 0.451    | 0.422    | 0.557     | ---       |
| Nov     | 0.337    | 0.409    | 0.351    | 0.523     | ---       |
| Dec     | 0.450    | 0.410    | 0.343    | 0.478     | ---       |
| Highest | 0.455    | 0.510    | 0.511    | 0.690     | 0.649     |
| Average | 0.402    | 0.458    | 0.438    | 0.459     | 0.582     |
| Lowest  | 0.313    | 0.392    | 0.343    | 0.000     | 0.523     |



# Fleet Events By Date Range

Lago Vista

Date Range:

9/1/2024 - 9/30/2024

**Date:** 9/23/2024

**Status:** Complete

**Assigned To:** Carl Sanders

**Event ID:** E6001

**Event Type:** Maintenance

**Work Order ID:**

**Feature ID:** Case Backhoe 580 Super  
N

**Feature Class:** Fleet Unit

**Fee:**

**Note:** oil and fliter change, fuel filter changed. fuilids checked and topped off.

**Date:** 9/5/2024

**Status:** In Progress

**Assigned To:** Ernesto Rios

**Event ID:** Auction off

**Event Type:** Other

**Work Order ID:**

**Feature ID:** Chevy 2500 Pickup

**Feature Class:** Fleet Unit

**Fee:**

**Note:** This Vehicle will be removed from our fleet this fiscal year

**Date:** 9/23/2024

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** 3009

**Event Type:** Other

**Work Order ID:**

**Feature ID:** Ford XLF250 Pickup

**Feature Class:** Fleet Unit

**Fee:**

**Note:** new tires mounted and balanced, fluids checked and topped off

**Date:** 9/23/2024

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** 6006

**Event Type:** Maintenance

**Work Order ID:**

**Feature ID:** Ford F250 Pickup

**Feature Class:** Fleet Unit

**Fee:**

**Note:** oil and fliter changed, fluids checked and topped off.

**Date:** 9/23/2024

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** 3007

**Event Type:** Service

**Work Order ID:**

**Feature ID:** Chevy 2500 Silverado

**Feature Class:** Fleet Unit

**Fee:**

**Note:** new tires mounted and balanced, fluids checked and topped off

**Date:** 9/26/2024

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** 6717

**Event Type:** Other

**Work Order ID:**

**Feature ID:** Chevy Silverado Pickup

**Feature Class:** Fleet Unit

**Fee:**

**Note:** new tires installed and alignment done by phoenix automotive.

**Date:** 9/30/2024

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** 3008

**Event Type:** Maintenance

**Work Order ID:**

**Feature ID:** Chevy 3500HD Pickup

**Feature Class:** Fleet Unit

**Fee:**

**Note:** oil and filter changed. fluids checked and topped off

**Total**

7



# Work Management Requests

## Lago Vista

Date Range: 9/1/2024 - 9/30/2024

| Start Date         | End Date           | Status      | Request ID                                 | Type      | Sub Type               | Assigned To   |
|--------------------|--------------------|-------------|--------------------------------------------|-----------|------------------------|---------------|
| 9/30/2024 12:00 AM | 10/3/2024 12:00 AM | In Progress | (Valve Exersing) Pg41                      | Utilities | Valve Issue/Exercising | Luis Mendoza  |
| 9/29/2024 12:00 AM | 9/29/2024 12:00 AM | On Hold     | FH Replacement: Round Up                   | Utilities | FH Issue/Replacement   | Steve Castro  |
| 9/24/2024 12:00 AM | 9/24/2024 12:00 AM | In Progress | (WATER LEAK) ENTRANCE TO SEWER PLANT       | Utilities | Water Leak             | Steve Castro  |
| 9/24/2024 12:00 AM | 9/24/2024 12:00 AM | Pending     | (SEWER SERVICE INSTALL) 2310 MACARTHUR AVE | Utilities | Other                  | Steve Castro  |
| 9/24/2024 12:00 AM | 9/24/2024 12:00 AM | Complete    | (METER SET) 2310 MACARTHUR AVE             | Utilities | Other                  | Jamie Nichols |
| 9/23/2024 12:00 AM | 9/23/2024 12:00 AM | Complete    | (METER SET) 21424 SANTA ROSA AVE           | Utilities | Other                  | Jamie Nichols |
| 9/23/2024 12:00 AM | 9/23/2024 12:00 AM | Complete    | (METER SET) 22617 GOLDEN DAISY LN          | Utilities | Other                  | Jamie Nichols |
| 9/23/2024 12:00 AM | 9/23/2024 12:00 AM | Complete    | (METER SET) 22709 GOLDEN DAISY LN          | Utilities | Other                  | Jamie Nichols |
| 9/23/2024 12:00 AM | 9/23/2024 12:00 AM | Complete    | (METER SET) 21903 PATTON CV                | Utilities | Other                  | Jamie Nichols |
| 9/19/2024 12:00 AM | 9/19/2024 12:00 AM | Complete    | (WATER LEAK) 21203 BLUFF RIDGE CV          | Utilities | Water Leak             | Steve Castro  |
| 9/19/2024 12:00 AM | 9/19/2024 12:00 AM | Complete    | (METER SET) 7416 DESERT NEEDLE DR          | Utilities | Other                  | Jamie Nichols |
| 9/19/2024 12:00 AM | 9/19/2024 12:00 AM | Complete    | (METER SET) 7405 DESERT NEEDLE DR          | Utilities | Other                  | Jamie Nichols |
| 9/19/2024 12:00 AM | 9/19/2024 12:00 AM | Complete    | (METER SET) 4400 LINDBERG LN               | Utilities | Other                  | Jamie Nichols |
| 9/19/2024 12:00 AM | 9/19/2024 12:00 AM | Complete    | (METER SET) 7420 DESERT NEEDLE DR          | Utilities | Other                  | Jamie Nichols |
| 9/18/2024 12:00 AM | 9/18/2024 12:00 AM | Pending     | (METER SET) 8006 SHINING FLOR RUN          | Utilities | Other                  | Jamie Nichols |

| Start Date         | End Date           | Status      | Request ID                        | Type      | Sub Type   | Assigned To   |
|--------------------|--------------------|-------------|-----------------------------------|-----------|------------|---------------|
| 9/18/2024 12:00 AM | 9/18/2024 12:00 AM | Complete    | (METER SET) 8009 SHINING FLOR RUN | Utilities | Other      | Jamie Nichols |
| 9/18/2024 12:00 AM | 9/18/2024 12:00 AM | Complete    | (METER SET) 8007 SHINING FLOR RUN | Utilities | Other      | Jamie Nichols |
| 9/18/2024 12:00 AM | 9/18/2024 12:00 AM | Complete    | (METER SET) 8004 SHINING FLOR RUN | Utilities | Other      | Jamie Nichols |
| 9/18/2024 12:00 AM | 9/18/2024 12:00 AM | Complete    | (METER SET) 8005 SHINING FLOR RUN | Utilities | Other      | Jamie Nichols |
| 9/18/2024 12:00 AM | 9/18/2024 12:00 AM | Pending     | (METER SET) 8008 SHINING FLOR RUN | Utilities | Other      | Jamie Nichols |
| 9/17/2024 12:00 AM | 9/17/2024 12:00 AM | Complete    | (METER SET) 8003 SHINING FLOR RUN | Utilities | Other      | Jamie Nichols |
| 9/16/2024 12:00 AM | 9/16/2024 12:00 AM | Complete    | (SEWER LEAK) 21487 LAKEFRONT DR   | Utilities | Sewer Leak | Steve Castro  |
| 9/16/2024 12:00 AM | 9/16/2024 12:00 AM | Complete    | (METER SET) 22310 LAGO LOOKOUT LN | Utilities | Other      | Jamie Nichols |
| 9/16/2024 12:00 AM | 9/16/2024 12:00 AM | Complete    | (METER SET) 8001 SHINING FLOR RUN | Utilities | Other      | Jamie Nichols |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | Complete    | (METER SET) 8009 ROYAL MINT CV    | Utilities | Other      | Jamie Nichols |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | Complete    | (WATER LEAK) 7323 WHITE OAK DR    | Utilities | Other      | Steve Castro  |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | Complete    | (METER SET) 8105 ROYAL MINT CV    | Utilities | Other      | Jamie Nichols |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | In Progress | Truck 6019 (Needs a Part)         | Utilities | Other      | Joel Peer     |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | In Progress | Truck 6006 (Oil Change Needed)    | Utilities | Other      | Joel Peer     |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | In Progress | Truck 6010 (3 Issues)             | Utilities | Other      | Joel Peer     |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | Complete    | (METER SET) 8016 ROYAL MINT CV    | Utilities | Other      | Jamie Nichols |
| 9/12/2024 12:00 AM | 9/12/2024 12:00 AM | Complete    | (METER SET) 8100 ROYAL MINT CV    | Utilities | Other      | Jamie Nichols |

| Start Date         | End Date           | Status   | Request ID                                     | Type      | Sub Type   | Assigned To   |
|--------------------|--------------------|----------|------------------------------------------------|-----------|------------|---------------|
| 9/11/2024 12:00 AM | 9/11/2024 12:00 AM | Pending  | (METER SET) 8021 ROYAL MINT CV                 | Utilities | Other      | Jamie Nichols |
| 9/11/2024 12:00 AM | 9/11/2024 12:00 AM | Pending  | (METER SET) 8017 ROYAL MINT CV                 | Utilities | Other      | Jamie Nichols |
| 9/11/2024 12:00 AM | 9/11/2024 12:00 AM | Complete | (SEWER LEAK) 6801 CEDAR RIDGE                  | Utilities | Sewer Leak | Steve Castro  |
| 9/11/2024 12:00 AM | 9/11/2024 12:00 AM | Complete | (METER SET) 8001 ROYAL MINT CV                 | Utilities | Other      | Jamie Nichols |
| 9/11/2024 12:00 AM | 9/11/2024 12:00 AM | Complete | (METER SET) 8005 ROYAL MINT CV                 | Utilities | Other      | Jamie Nichols |
| 9/11/2024 12:00 AM | 9/11/2024 12:00 AM | Complete | (METER SET) 8004 ROYAL MINT CV                 | Utilities | Other      | Jamie Nichols |
| 9/11/2024 12:00 AM | 9/11/2024 12:00 AM | Complete | (METER SET) 8113 ROYAL MINT CV                 | Utilities | Other      | Jamie Nichols |
| 9/10/2024 12:00 AM | 9/10/2024 12:00 AM | Complete | (CHECK VALVE REPLACEMENT) 3301 Emerson         | Utilities | Other      | Jamie Nichols |
| 9/9/2024 12:00 AM  | 9/9/2024 12:00 AM  | Complete | (METER SET) 21805 TALLAHASSEE AVE              | Utilities | Other      | Jamie Nichols |
| 9/9/2024 12:00 AM  | 9/9/2024 12:00 AM  | Complete | (SEWER SERVICE INSTALL) 21805 TALLAHASSEE AVE  | Utilities | Other      | Steve Castro  |
| 9/4/2024 12:00 AM  | 9/4/2024 12:00 AM  | Pending  | (SEPTIC TO SEWER CONVERSION) 7503 WHITE OAK DR | Utilities | Other      | Steve Castro  |
| 9/4/2024 12:00 AM  | 9/4/2024 12:00 AM  | Complete | (SEWER CLOG) 1910 AMERICAN DR                  | Utilities | Other      | Steve Castro  |
| 9/4/2024 12:00 AM  | 9/4/2024 12:00 AM  | Complete | (METER SET) 7432 DESERT NEEDLE DR              | Utilities | Other      | Jamie Nichols |
| 9/4/2024 12:00 AM  | 9/4/2024 12:00 AM  | Complete | (METER SET) 7409 DESERT NEEDLE DR              | Utilities | Other      | Jamie Nichols |
| 9/4/2024 12:00 AM  | 9/4/2024 12:00 AM  | Complete | (WATER LEAK) 21909 SURREY LN                   | Utilities | Water Leak | Steve Castro  |
| 9/3/2024 12:00 AM  | 9/3/2024 12:00 AM  | Complete | (METER SET) 7428 DESERT NEEDLE DR              | Utilities | Other      | Jamie Nichols |
| 9/3/2024 12:00 AM  | 9/3/2024 12:00 AM  | Complete | (WATER LEAK) 3901 CLINTON LN                   | Utilities | Water Leak | Luis Mendoza  |

| Start Date        | End Date          | Status   | Request ID                                      | Type      | Sub Type | Assigned To  |
|-------------------|-------------------|----------|-------------------------------------------------|-----------|----------|--------------|
| 9/3/2024 12:00 AM | 9/5/2024 12:00 AM | Complete | (SEWER SERVICE INSTALL) 21424<br>SANTA ROSA AVE | Utilities | Other    | Steve Castro |
|                   |                   |          |                                                 | Total     | 50       |              |