

CITY OF LAGO VISTA WATER & WASTEWATER REPORT

February 2025



Water Production

This Month		Total Production - 30.290 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	8.754 MG	7.994 MG	91.3%	0.379 MG	0.286 MG	0.091 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	22.587 MG	22.296 MG	98.7%	1.280 MG	0.796 MG	0.643 MG
Combined	31.341 MG	30.290 MG	96.6%	1.372 MG	1.082 MG	0.888 MG
Past 12 Months		Total Production - 504.523 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	188.334 MG	175.556 MG	93.2%	0.845 MG	0.481 MG	0.091 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	333.019 MG	328.966 MG	98.8%	1.455 MG	0.901 MG	0.566 MG
Combined	521.352 MG	504.523 MG	96.8%	2.200 MG	1.382 MG	0.888 MG

Waste Water Treatment

This Month		Total Treated - 15.340 MG		
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	15.340 MG	0.650 MG	0.548 MG	0.440 MG
Past 12 Months		Total Treated - 209.616 MG		
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	209.616 MG	0.820 MG	0.574 MG	0.440 MG


Effluent Disposal

This Month		WWTP Plant Permit Total - 15.340 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	2.561 MG	0.183 MG	0.091 MG	0.010 MG	
Cedar Breaks Permit	18.584 MG	1.656 MG	0.664 MG	0.000 MG	
WWTP Plant Permit Total	15.340 MG	0.660 MG	0.548 MG	0.440 MG	
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG	
Past 12 Months		WWTP Plant Permit Total - 209.617 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	46.703 MG	2.892 MG	0.128 MG	0.000 MG	
Cedar Breaks Permit	133.077 MG	1.706 MG	0.365 MG	0.000 MG	
WWTP Plant Permit Total	209.617 MG	0.820 MG	0.574 MG	0.440 MG	
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG	

February 2025

Combined Water Production

This Month

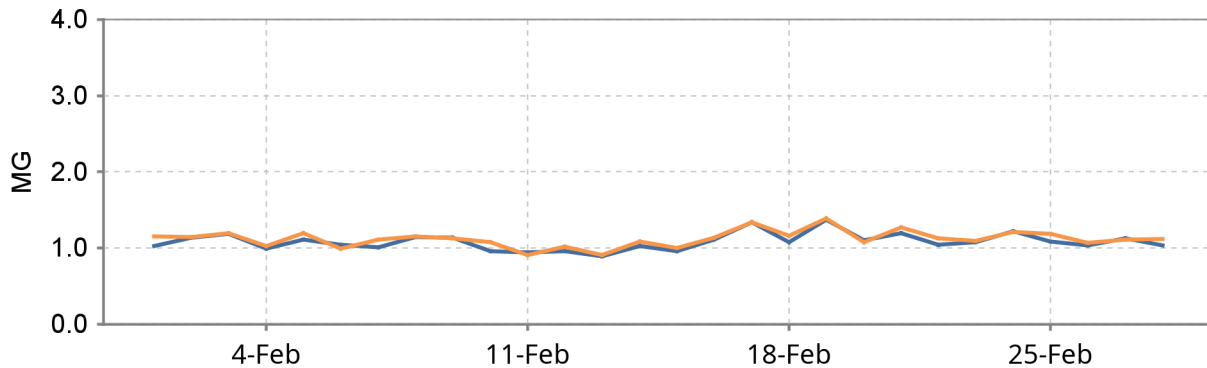


Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
02/01/25	0.364	---	0.787	1.150	0.324	---	0.705	1.029
02/02/25	0.312	---	0.834	1.146	0.306	---	0.830	1.136
02/03/25	0.425	---	0.772	1.197	0.369	---	0.812	1.182
02/04/25	0.301	---	0.724	1.025	0.277	---	0.716	0.994
02/05/25	0.353	---	0.839	1.192	0.337	---	0.771	1.108
02/06/25	0.290	---	0.701	0.991	0.274	---	0.771	1.045
02/07/25	0.384	---	0.725	1.109	0.326	---	0.682	1.008
02/08/25	0.322	---	0.831	1.153	0.317	---	0.824	1.141
02/09/25	0.353	---	0.771	1.123	0.339	---	0.796	1.135
02/10/25	0.353	---	0.722	1.075	0.285	---	0.670	0.955
02/11/25	0.249	---	0.659	0.908	0.235	---	0.704	0.939
02/12/25	0.270	---	0.747	1.017	0.264	---	0.693	0.957
02/13/25	0.259	---	0.646	0.905	0.245	---	0.643	0.888
02/14/25	0.291	---	0.793	1.084	0.245	---	0.779	1.024
02/15/25	0.322	---	0.678	1.000	0.297	---	0.660	0.957
02/16/25	0.302	---	0.831	1.133	0.282	---	0.826	1.108
02/17/25	0.374	---	0.959	1.333	0.336	---	1.001	1.338
02/18/25	0.260	---	0.901	1.161	0.233	---	0.841	1.074
02/19/25	0.104	---	1.280	1.384	0.091	---	1.280	1.372
02/20/25	0.322	---	0.755	1.078	0.316	---	0.788	1.104
02/21/25	0.374	---	0.892	1.266	0.325	---	0.864	1.190
02/22/25	0.280	---	0.848	1.128	0.256	---	0.790	1.046
02/23/25	0.228	---	0.866	1.095	0.214	---	0.860	1.074
02/24/25	0.385	---	0.823	1.208	0.379	---	0.836	1.215
02/25/25	0.332	---	0.853	1.184	0.264	---	0.818	1.082
02/26/25	0.301	---	0.768	1.069	0.286	---	0.744	1.030
02/27/25	0.312	---	0.800	1.111	0.306	---	0.823	1.129
02/28/25	0.333	---	0.783	1.116	0.266	---	0.767	1.033
Total (MG)	8.754	0.000	22.587	31.341	7.994	0.000	22.296	30.290
Highest	0.425	---	1.280	1.384	0.379	---	1.280	1.372
Average	0.313	0.000	0.807	1.119	0.286	0.000	0.796	1.082
Lowest	0.104	---	0.646	0.905	0.091	---	0.643	0.888

February 2025

Water Plant 1 Water Production

This Month

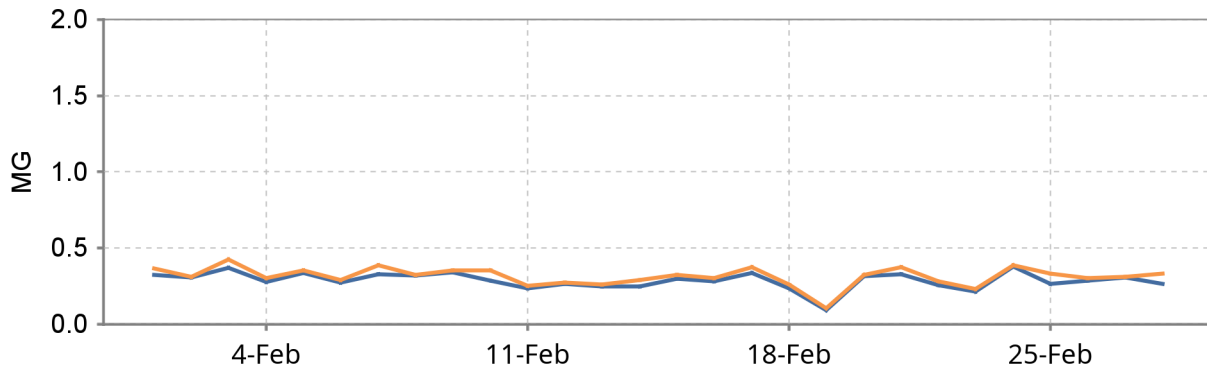


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
02/01/25	0.364	0.000	0.364	0.324	0.040	89%
02/02/25	0.312	0.000	0.312	0.306	0.006	98%
02/03/25	0.425	0.000	0.425	0.369	0.056	87%
02/04/25	0.301	0.000	0.301	0.277	0.024	92%
02/05/25	0.353	0.000	0.353	0.337	0.016	95%
02/06/25	0.290	0.000	0.290	0.274	0.016	94%
02/07/25	0.384	0.000	0.384	0.326	0.058	85%
02/08/25	0.322	0.000	0.322	0.317	0.005	98%
02/09/25	0.353	0.000	0.353	0.339	0.014	96%
02/10/25	0.353	0.000	0.353	0.285	0.068	81%
02/11/25	0.249	0.000	0.249	0.235	0.014	94%
02/12/25	0.270	0.000	0.270	0.264	0.006	98%
02/13/25	0.259	0.000	0.259	0.245	0.014	95%
02/14/25	0.291	0.000	0.291	0.245	0.046	84%
02/15/25	0.322	0.000	0.322	0.297	0.026	92%
02/16/25	0.302	0.000	0.302	0.282	0.020	93%
02/17/25	0.374	0.000	0.374	0.336	0.038	90%
02/18/25	0.260	0.000	0.260	0.233	0.027	90%
02/19/25	0.104	0.000	0.104	0.091	0.012	88%
02/20/25	0.322	0.000	0.322	0.316	0.006	98%
02/21/25	0.374	0.000	0.374	0.325	0.049	87%
02/22/25	0.280	0.000	0.280	0.256	0.024	91%
02/23/25	0.228	0.000	0.228	0.214	0.014	94%
02/24/25	0.385	0.000	0.385	0.379	0.006	98%
02/25/25	0.332	0.000	0.332	0.264	0.067	80%
02/26/25	0.301	0.000	0.301	0.286	0.016	95%
02/27/25	0.312	0.000	0.312	0.306	0.006	98%
02/28/25	0.333	0.000	0.332	0.266	0.067	80%
Total (MG)	8.754	0.000	8.753	7.994	0.760	-
Highest	0.425	0.000	0.425	0.379	-	-
Average	0.313	0.000	0.313	0.286	-	91%
Lowest	0.104	0.000	0.104	0.091	-	-

February 2025

Water Plant 2 Water Production

This Month

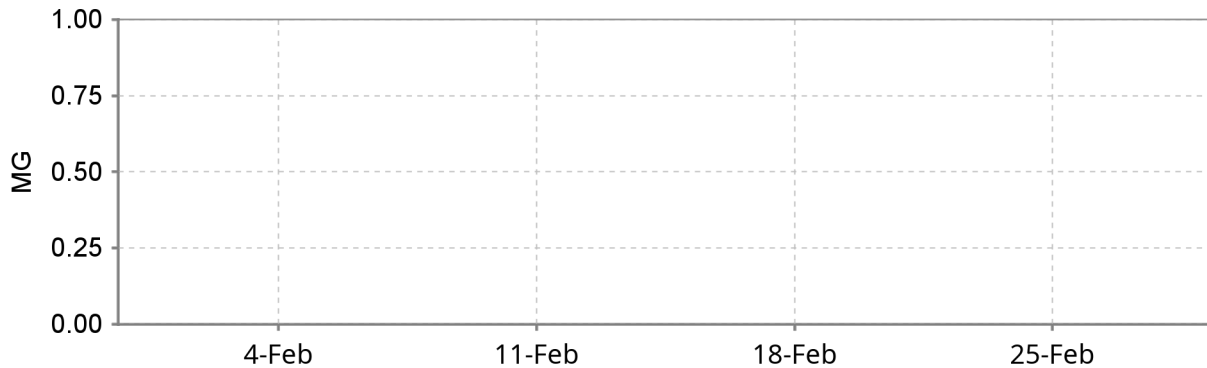


Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
02/01/25	---	---	---	---	---	---	---%
02/02/25	---	---	---	---	---	---	---%
02/03/25	---	---	---	---	---	---	---%
02/04/25	---	---	---	---	---	---	---%
02/05/25	---	---	---	---	---	---	---%
02/06/25	---	---	---	---	---	---	---%
02/07/25	---	---	---	---	---	---	---%
02/08/25	---	---	---	---	---	---	---%
02/09/25	---	---	---	---	---	---	---%
02/10/25	---	---	---	---	---	---	---%
02/11/25	---	---	---	---	---	---	---%
02/12/25	---	---	---	---	---	---	---%
02/13/25	---	---	---	---	---	---	---%
02/14/25	---	---	---	---	---	---	---%
02/15/25	---	---	---	---	---	---	---%
02/16/25	---	---	---	---	---	---	---%
02/17/25	---	---	---	---	---	---	---%
02/18/25	---	---	---	---	---	---	---%
02/19/25	---	---	---	---	---	---	---%
02/20/25	---	---	---	---	---	---	---%
02/21/25	---	---	---	---	---	---	---%
02/22/25	---	---	---	---	---	---	---%
02/23/25	---	---	---	---	---	---	---%
02/24/25	---	---	---	---	---	---	---%
02/25/25	---	---	---	---	---	---	---%
02/26/25	---	---	---	---	---	---	---%
02/27/25	---	---	---	---	---	---	---%
02/28/25	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

February 2025

Water Plant 3 Water Production

This Month

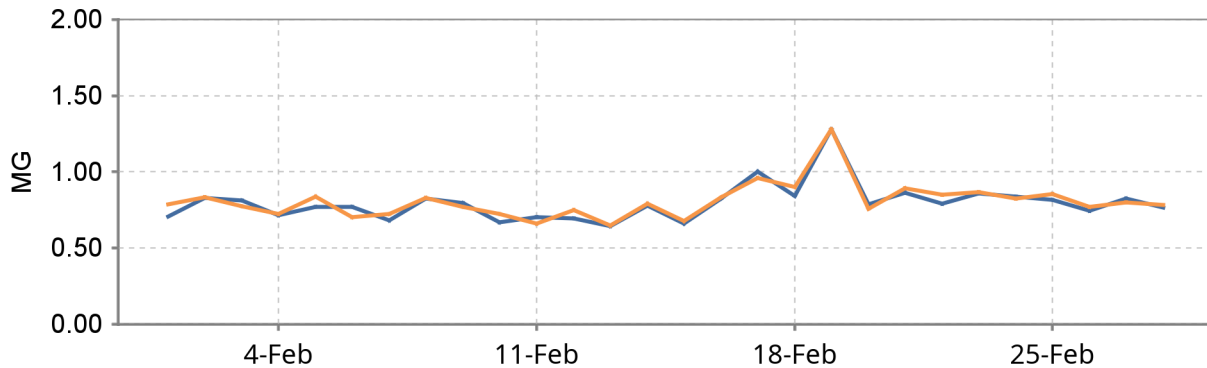


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
02/01/25	0.787	0.841	0.000	0.003	0.705	0.082	90%
02/02/25	0.834	0.841	0.000	0.000	0.830	0.004	100%
02/03/25	0.772	0.874	0.000	0.104	0.812	-0.040	105%
02/04/25	0.724	0.725	0.000	0.001	0.716	0.008	99%
02/05/25	0.839	0.898	0.000	0.050	0.771	0.068	92%
02/06/25	0.701	0.735	0.000	0.006	0.771	-0.071	110%
02/07/25	0.725	0.726	0.000	0.000	0.682	0.043	94%
02/08/25	0.831	0.865	0.000	0.034	0.824	0.007	99%
02/09/25	0.771	0.762	0.000	0.009	0.796	-0.025	103%
02/10/25	0.722	0.713	0.000	0.000	0.670	0.052	93%
02/11/25	0.659	0.669	0.000	0.000	0.704	-0.045	107%
02/12/25	0.747	0.730	0.000	0.000	0.693	0.054	93%
02/13/25	0.646	0.709	0.000	0.053	0.643	0.003	100%
02/14/25	0.793	0.805	0.000	0.004	0.779	0.014	98%
02/15/25	0.678	0.674	0.000	0.000	0.660	0.017	97%
02/16/25	0.831	0.916	0.000	0.085	0.826	0.005	99%
02/17/25	0.959	0.943	0.000	0.000	1.001	-0.042	104%
02/18/25	0.901	0.996	0.000	0.084	0.841	0.060	93%
02/19/25	1.280	1.384	0.000	0.096	1.280	0.000	100%
02/20/25	0.755	0.738	0.000	0.000	0.788	-0.032	104%
02/21/25	0.892	0.926	0.000	0.062	0.864	0.027	97%
02/22/25	0.848	0.861	0.000	0.002	0.790	0.058	93%
02/23/25	0.866	0.863	0.000	0.000	0.860	0.006	99%
02/24/25	0.823	0.894	0.000	0.039	0.836	-0.013	102%
02/25/25	0.853	0.820	0.000	0.001	0.818	0.035	96%
02/26/25	0.768	0.744	0.000	0.000	0.744	0.024	97%
02/27/25	0.800	0.996	0.000	0.177	0.823	-0.023	103%
02/28/25	0.783	0.812	0.000	0.005	0.767	0.016	98%
Total (MG)	22.587	23.460	0.000	0.816	22.296	0.291	-
Highest	1.280	1.384	0.000	0.177	1.280	-	-
Average	0.807	0.838	0.000	0.029	0.796	-	99%
Lowest	0.646	0.669	0.000	0.000	0.643	-	-

February 2025

Waste Water Treatment

This Month

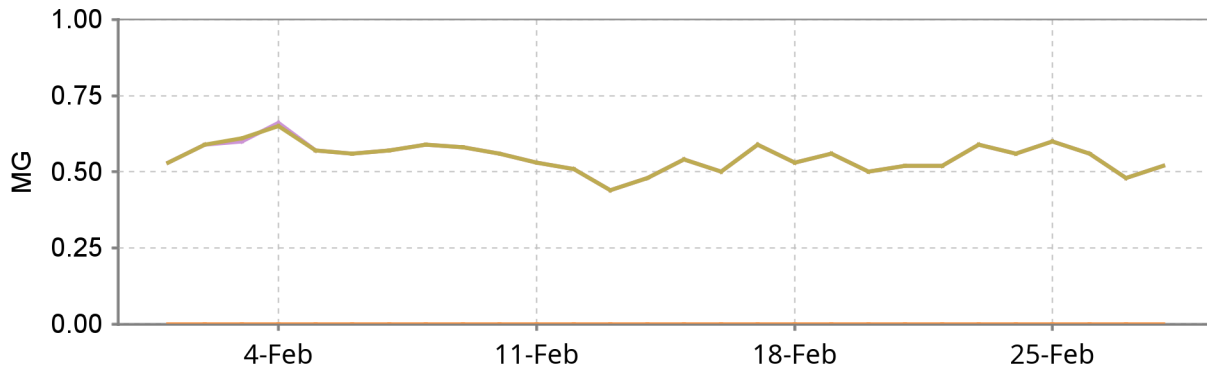


Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
02/01/25	0.530	0.091	0.572	0.530	0.000
02/02/25	0.590	0.091	0.000	0.590	0.000
02/03/25	0.610	0.091	0.000	0.600	0.000
02/04/25	0.650	0.101	1.656	0.660	0.000
02/05/25	0.570	0.121	1.290	0.570	0.000
02/06/25	0.560	0.121	0.228	0.560	0.000
02/07/25	0.570	0.112	0.006	0.570	0.000
02/08/25	0.590	0.101	0.000	0.590	0.000
02/09/25	0.580	0.142	0.871	0.580	0.000
02/10/25	0.560	0.122	1.116	0.560	0.000
02/11/25	0.530	0.101	0.784	0.530	0.000
02/12/25	0.510	0.101	1.072	0.510	0.000
02/13/25	0.440	0.111	1.115	0.440	0.000
02/14/25	0.480	0.101	1.105	0.480	0.000
02/15/25	0.540	0.101	0.042	0.540	0.000
02/16/25	0.500	0.111	0.879	0.500	0.000
02/17/25	0.590	0.111	1.199	0.590	0.000
02/18/25	0.530	0.020	0.261	0.530	0.000
02/19/25	0.560	0.020	0.005	0.560	0.000
02/20/25	0.500	0.010	0.000	0.500	0.000
02/21/25	0.520	0.020	0.000	0.520	0.000
02/22/25	0.520	0.101	0.812	0.520	0.000
02/23/25	0.590	0.142	1.134	0.590	0.000
02/24/25	0.560	0.081	1.004	0.560	0.000
02/25/25	0.600	0.121	0.934	0.600	0.000
02/26/25	0.560	0.183	0.913	0.560	0.000
02/27/25	0.480	0.010	1.041	0.480	0.000
02/28/25	0.520	0.021	0.544	0.520	0.000
Total (MG)	15.340	2.561	18.584	15.340	0.000
Highest	0.650	0.183	1.656	0.660	0.000
Average	0.548	0.091	0.664	0.548	0.000
Lowest	0.440	0.010	0.000	0.440	0.000

February 2025

Effluent Disposal


This Month

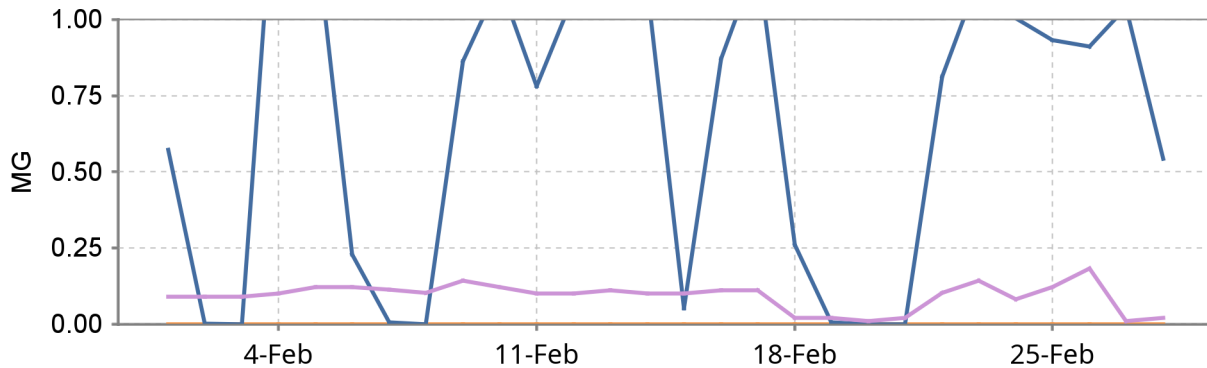

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
02/01/25	0.091	0.091	0.572	0.572	0.000	0.000	0.000	---
02/02/25	0.091	0.091	0.000	0.000	0.000	0.000	0.000	---
02/03/25	0.091	0.091	0.000	0.000	0.000	0.000	0.000	---
02/04/25	0.101	0.101	1.656	1.656	0.000	0.000	0.000	---
02/05/25	0.121	0.121	1.290	1.290	0.000	0.000	0.000	---
02/06/25	0.121	0.121	0.228	0.228	0.000	0.000	0.000	---
02/07/25	0.112	0.112	0.006	0.006	0.000	0.000	0.000	---
02/08/25	0.101	0.101	0.000	0.000	0.000	0.000	0.000	---
02/09/25	0.142	0.142	0.864	0.871	0.000	0.000	0.000	---
02/10/25	0.122	0.122	1.122	1.116	0.000	0.000	0.000	---
02/11/25	0.101	0.101	0.782	0.784	0.000	0.000	0.000	---
02/12/25	0.101	0.101	1.081	1.072	0.000	0.000	0.000	---
02/13/25	0.111	0.111	1.108	1.115	0.000	0.000	0.000	---
02/14/25	0.101	0.101	1.102	1.105	0.000	0.000	0.000	---
02/15/25	0.101	0.101	0.052	0.042	0.000	0.000	0.000	---
02/16/25	0.111	0.111	0.873	0.879	0.000	0.000	0.000	---
02/17/25	0.111	0.111	1.199	1.199	0.000	0.000	0.000	---
02/18/25	0.020	0.020	0.261	0.261	0.000	0.000	0.000	---
02/19/25	0.020	0.020	0.005	0.005	0.000	0.000	0.000	---
02/20/25	0.010	0.010	0.000	0.000	0.000	0.000	0.000	---
02/21/25	0.020	0.020	0.000	0.000	0.000	0.000	0.000	---
02/22/25	0.101	0.101	0.812	0.812	0.000	0.000	0.000	---
02/23/25	0.142	0.142	1.134	1.134	0.000	0.000	0.000	---
02/24/25	0.081	0.081	1.004	1.004	0.000	0.000	0.000	---
02/25/25	0.121	0.121	0.934	0.934	0.000	0.000	0.000	---
02/26/25	0.183	0.183	0.913	0.913	0.000	0.000	0.000	---
02/27/25	0.010	0.010	1.041	1.041	0.000	0.000	0.000	---
02/28/25	0.021	0.021	0.544	0.544	0.000	0.000	0.000	---
Total (MG)	2.561	2.561	18.584	18.584	0.000	0.000	0.000	0.000
Highest	0.183	0.183	1.656	1.656	0.000	0.000	0.000	---
Average	0.091	0.091	0.664	0.664	0.000	0.000	0.000	0.000
Lowest	0.010	0.010	0.000	0.000	0.000	0.000	0.000	---

Combined Water Production


Past 12 Months

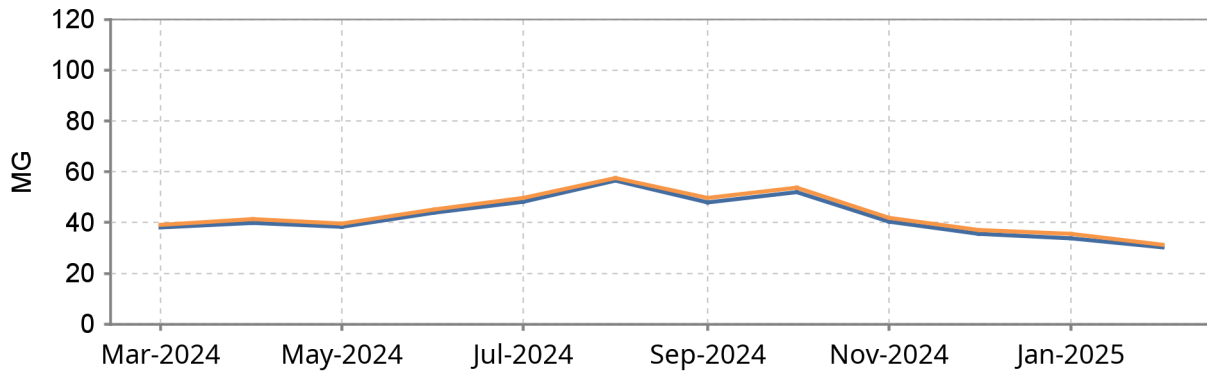

Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
Mar, 2024	9.271	---	29.837	39.108	8.548	---	29.469	38.017
Apr, 2024	11.258	---	30.009	41.267	10.391	---	29.535	39.926
May, 2024	11.888	---	27.620	39.509	10.941	---	27.285	38.226
Jun, 2024	17.020	---	28.194	45.214	15.963	---	27.872	43.835
Jul, 2024	18.856	---	30.889	49.745	17.765	---	30.557	48.322
Aug, 2024	21.790	---	35.757	57.547	21.129	---	35.392	56.521
Sep, 2024	21.205	---	28.396	49.601	19.761	---	28.103	47.864
Oct, 2024	23.252	---	30.507	53.759	21.669	---	30.228	51.897
Nov, 2024	17.782	---	23.999	41.782	16.545	---	23.802	40.347
Dec, 2024	15.482	---	21.496	36.978	14.160	---	21.328	35.489
Jan, 2025	11.775	---	23.728	35.503	10.690	---	23.098	33.788
Feb, 2025	8.754	---	22.587	31.341	7.994	---	22.296	30.290
Total (MG)	188.334	0.000	333.019	521.352	175.556	0.000	328.966	504.523
Highest	23.252	---	35.757	57.547	21.669	---	35.392	56.521
Average	15.694	0.000	27.752	43.446	14.630	0.000	27.414	42.044
Lowest	8.754	---	21.496	31.341	7.994	---	21.328	30.290

Water Plant 1 Water Production


Past 12 Months

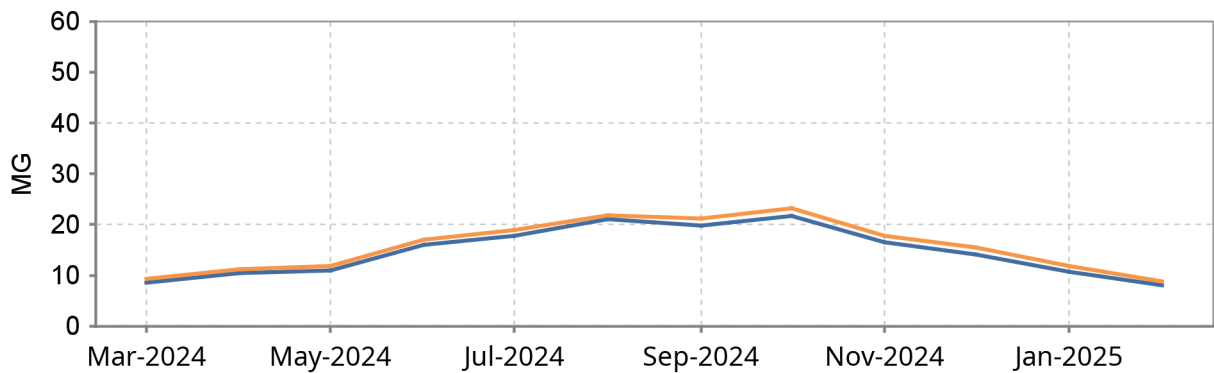

Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
Mar, 2024	9.271	5.707	3.560	8.548	0.723	92%
Apr, 2024	11.258	6.728	4.536	10.391	0.867	92%
May, 2024	11.888	7.086	4.774	10.941	0.947	92%
Jun, 2024	17.020	10.271	6.757	15.963	1.057	94%
Jul, 2024	18.856	11.355	7.502	17.765	1.092	94%
Aug, 2024	21.790	11.931	9.852	21.129	0.660	97%
Sep, 2024	21.205	11.803	9.402	19.761	1.444	93%
Oct, 2024	23.252	13.178	10.071	21.669	1.583	93%
Nov, 2024	17.782	10.107	7.674	16.545	1.237	93%
Dec, 2024	15.482	8.354	7.137	14.160	1.322	91%
Jan, 2025	11.775	2.509	9.264	10.690	1.085	91%
Feb, 2025	8.754	0.000	8.753	7.994	0.760	91%
Total (MG)	188.334	99.030	89.283	175.556	12.777	-
Highest	23.252	13.178	10.071	21.669	-	-
Average	15.694	8.252	7.440	14.630	-	93%
Lowest	8.754	0.000	3.560	7.994	-	-

Water Plant 2 Water Production


Past 12 Months

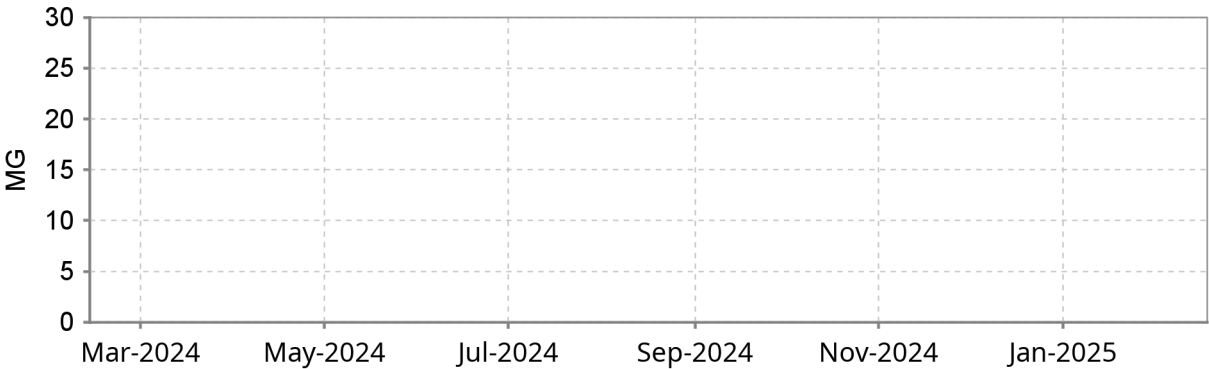

Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
Mar, 2024	---	---	---	---	---	---	---%
Apr, 2024	---	---	---	---	---	---	---%
May, 2024	---	---	---	---	---	---	---%
Jun, 2024	---	---	---	---	---	---	---%
Jul, 2024	---	---	---	---	---	---	---%
Aug, 2024	---	---	---	---	---	---	---%
Sep, 2024	---	---	---	---	---	---	---%
Oct, 2024	---	---	---	---	---	---	---%
Nov, 2024	---	---	---	---	---	---	---%
Dec, 2024	---	---	---	---	---	---	---%
Jan, 2025	---	---	---	---	---	---	---%
Feb, 2025	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

Water Plant 3 Water Production

Past 12 Months

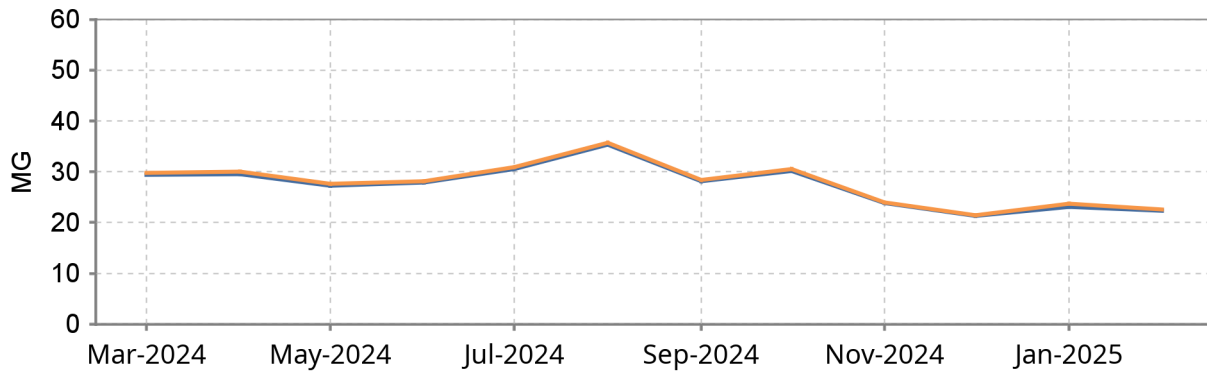


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
Mar, 2024	29.837	30.560	0.000	0.495	29.469	0.368	99%
Apr, 2024	30.009	30.600	0.000	0.494	29.535	0.474	98%
May, 2024	27.620	28.178	0.000	0.440	27.285	0.335	99%
Jun, 2024	28.194	28.739	0.000	0.495	27.872	0.322	99%
Jul, 2024	30.889	31.464	0.000	0.495	30.557	0.331	99%
Aug, 2024	35.757	36.729	0.000	0.768	35.392	0.365	99%
Sep, 2024	28.396	29.176	0.000	0.605	28.103	0.293	99%
Oct, 2024	30.507	31.274	0.000	0.656	30.228	0.279	99%
Nov, 2024	23.999	24.710	0.000	0.556	23.802	0.197	99%
Dec, 2024	21.496	22.048	0.000	0.422	21.328	0.168	99%
Jan, 2025	23.728	24.508	0.000	0.790	23.098	0.630	97%
Feb, 2025	22.587	23.460	0.000	0.816	22.296	0.291	99%
Total (MG)	333.019	341.446	0.000	7.032	328.966	4.052	-
Highest	35.757	36.729	0.000	0.816	35.392	-	-
Average	27.752	28.454	0.000	0.586	27.414	-	99%
Lowest	21.496	22.048	0.000	0.422	21.328	-	-

February 2025

Waste Water Treatment


Past 12 Months

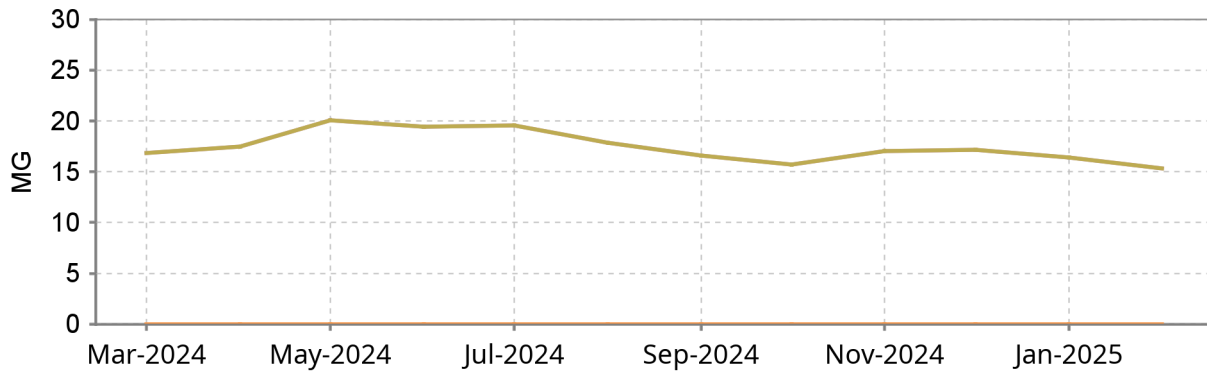

Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
Mar, 2024	16.836	0.000	0.000	16.836	0.000
Apr, 2024	17.490	3.467	12.976	17.490	0.000
May, 2024	20.104	4.413	3.674	20.104	0.000
Jun, 2024	19.447	5.109	0.000	19.447	0.000
Jul, 2024	19.570	4.772	0.000	19.570	0.000
Aug, 2024	17.850	5.993	0.000	17.850	0.000
Sep, 2024	16.627	4.633	4.363	16.627	0.000
Oct, 2024	15.722	6.327	23.827	15.722	0.000
Nov, 2024	17.031	4.601	20.445	17.031	0.000
Dec, 2024	17.160	2.608	23.415	17.160	0.000
Jan, 2025	16.439	2.218	25.795	16.440	0.000
Feb, 2025	15.340	2.561	18.584	15.340	0.000
Total (MG)	209.616	46.703	133.077	209.617	0.000
Highest	20.104	6.327	25.795	20.104	0.000
Average	17.468	3.892	11.090	17.468	0.000
Lowest	15.340	0.000	0.000	15.340	0.000

Effluent Disposal


Past 12 Months

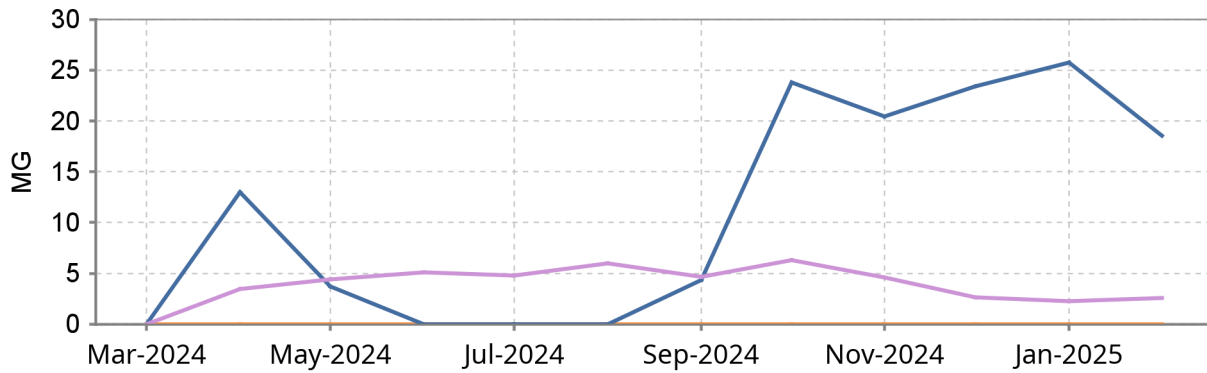

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
Mar, 2024	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
Apr, 2024	3.467	3.467	12.981	12.976	0.000	0.000	0.000	---
May, 2024	4.413	4.413	3.674	3.674	0.000	0.000	0.000	---
Jun, 2024	5.109	5.109	0.000	0.000	0.000	0.000	0.000	---
Jul, 2024	4.772	4.772	0.000	0.000	0.000	0.000	0.000	---
Aug, 2024	5.993	5.993	0.000	0.000	0.000	0.000	0.000	---
Sep, 2024	4.633	4.633	4.363	4.363	0.000	0.000	0.000	---
Oct, 2024	6.327	6.327	23.827	23.827	0.000	0.000	0.000	---
Nov, 2024	4.601	4.601	20.445	20.445	0.000	0.000	0.000	---
Dec, 2024	2.605	2.608	23.415	23.415	0.000	0.000	0.000	---
Jan, 2025	2.221	2.218	25.795	25.795	0.000	0.000	0.000	---
Feb, 2025	2.561	2.561	18.584	18.584	0.000	0.000	0.000	---
Total (MG)	46.703	46.703	133.083	133.077	0.000	0.000	0.000	0.000
Highest	6.327	6.327	25.795	25.795	0.000	0.000	0.000	---
Average	3.892	3.892	11.090	11.090	0.000	0.000	0.000	0.000
Lowest	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---

Combined Water Production

5 Year Average Daily Production

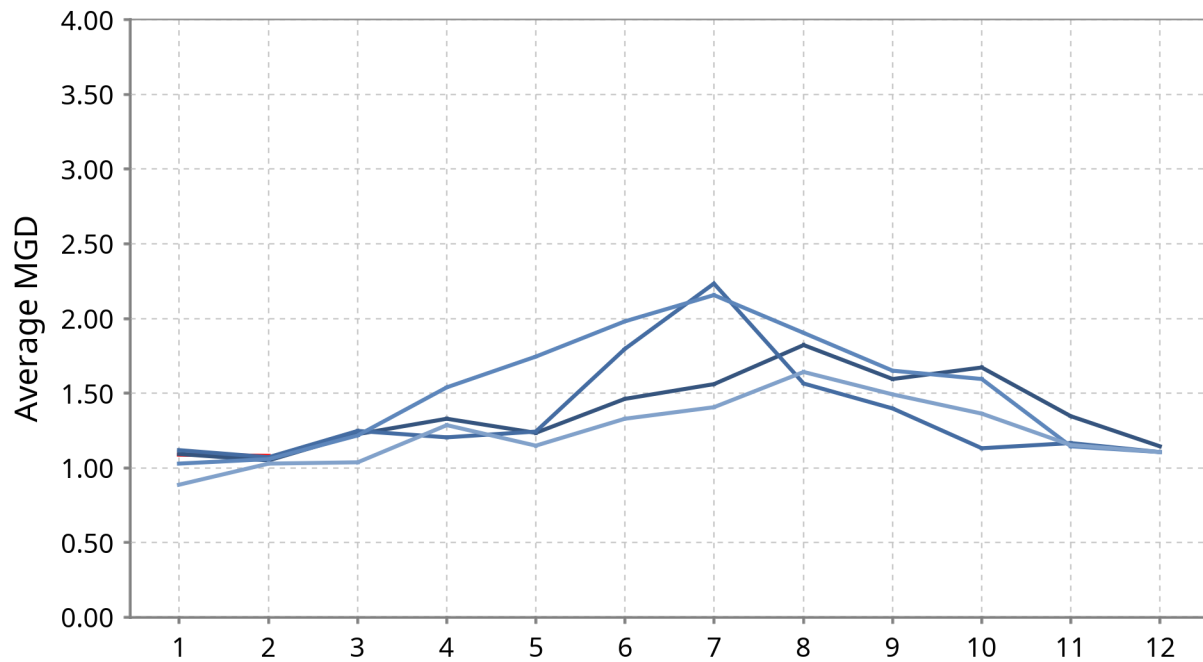


Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.888	1.027	1.118	1.092	1.090
Feb	1.030	1.059	1.073	1.052	1.082
Mar	1.039	1.217	1.246	1.226	---
Apr	1.285	1.541	1.205	1.331	---
May	1.149	1.744	1.243	1.233	---
Jun	1.330	1.982	1.796	1.461	---
Jul	1.407	2.158	2.233	1.559	---
Aug	1.642	1.905	1.563	1.823	---
Sep	1.492	1.652	1.400	1.595	---
Oct	1.365	1.594	1.133	1.674	---
Nov	1.153	1.144	1.166	1.345	---
Dec	1.105	1.108	1.107	1.145	---

Highest	1.642	2.158	2.233	1.823	1.090
Average	1.240	1.511	1.357	1.378	1.086
Lowest	0.888	1.027	1.073	1.052	1.082

Waste Water Treatment

5 Year Average Daily Treated

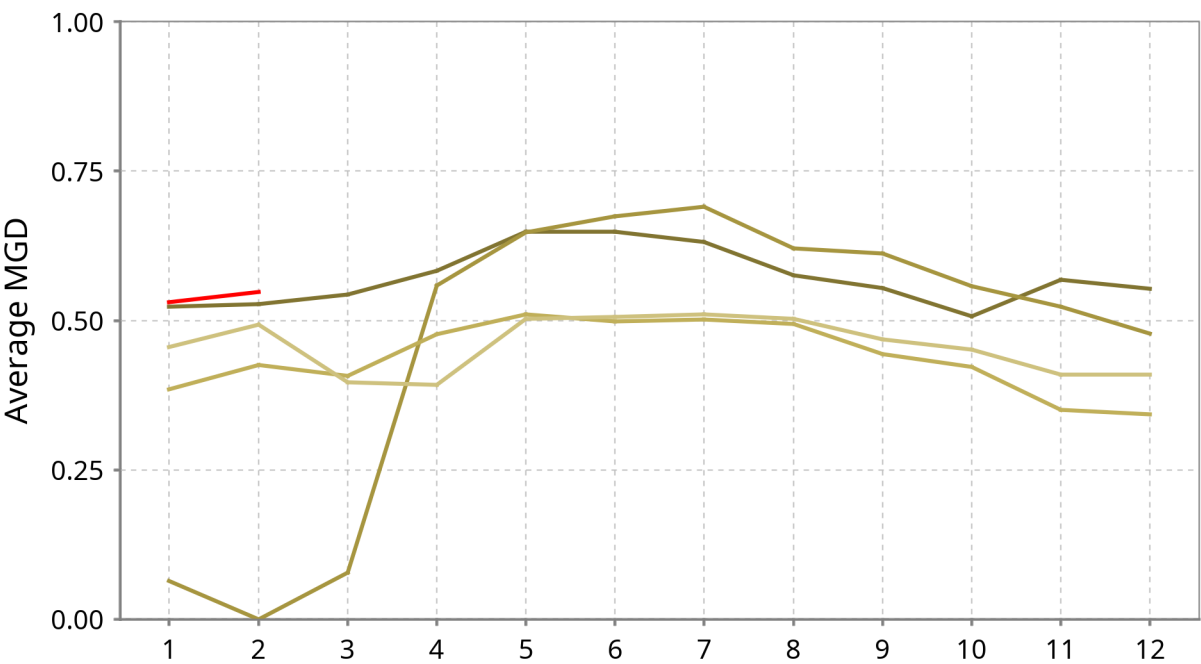

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.456	0.385	0.064	0.523	0.530
Feb	0.493	0.425	0.000	0.528	0.548
Mar	0.396	0.407	0.078	0.543	---
Apr	0.392	0.477	0.559	0.583	---
May	0.503	0.511	0.648	0.649	---
Jun	0.506	0.499	0.675	0.648	---
Jul	0.510	0.502	0.690	0.631	---
Aug	0.503	0.494	0.620	0.576	---
Sep	0.469	0.443	0.612	0.554	---
Oct	0.451	0.422	0.557	0.507	---
Nov	0.409	0.351	0.523	0.568	---
Dec	0.410	0.343	0.478	0.554	---
Highest	0.510	0.511	0.690	0.649	0.548
Average	0.458	0.438	0.459	0.572	0.539
Lowest	0.392	0.343	0.000	0.507	0.530

City of Lago Vista Monthly Water Accounting Report



For the Month of: **January**

Year: **2025**

WATER PRODUCED (GAL)

1 Water Produced **TOTAL PRODUCED: 33,788,000**

WATER SOLD (GAL)

2	Residential	22,029,600	
3	Commercial	2,171,100	
4	City Irrigation	250,900	
5	Fire Hydrant Meters	330,000	
6	City Meters (Y & Z routes)	2,344,900	
7	Other Sales (explain): 2nd meter	89,000	
8	TOTAL WATER SOLD:	27,215,500	80.55%

BREAKDOWN OF UNBILLED WATER USAGE (GAL)

9	Water Treatment Plant #1: Process Loss	1,085,000
10	Water Treatment Plant # 3: Process Loss & Backwash	630,000
11	Wastewater Treatment Plant:	476,200
12	System Flushing	1,000
13	Fire Department Usage:	5,000
14	Other Usage (explain): off, not charged	19,582
15	lines 9-14 TOTAL UNBILLED WATER USAGE	2,216,782

BREAKDOWN OF KNOWN WATER LOST (GAL)

16	Tank Overflows/Drainage	40,000
17	Excavation Breaks	0
18	Water Line Breaks	50,000
19	lines 16-18 TOTAL KNOWN WATER LOST	90,000

TOTAL UNACCOUNTED WATER LOSS (GAL)

20 **TOTAL UNACCOUNTED WATER: 4,265,718 12.62%**



Work Management Requests

Lago Vista

Date Range: 2/1/2025 - 2/28/2025

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
2/27/2025 12:00 AM	2/27/2025 12:00 AM	In Progress	(SEWER ISSUE) 20029CONTINENTAL DR	Utilities	Other	Jamie Nichols
2/27/2025 12:00 AM	2/27/2025 12:00 AM	In Progress	(WATER LEAK) 8506 TALON CIRCLE	Utilities	Water Leak	Steve Castro
2/27/2025 12:00 AM	2/27/2025 12:00 AM	In Progress	(WATER LEAK) 21306 BROKEN BOW CV	Utilities	Water Leak	Steve Castro
2/26/2025 12:00 AM	2/26/2025 12:00 AM	In Progress	(WATER LEAK) 5911 LAGO VISTA WAY	Utilities	Water Leak	Luis Mendoza
2/26/2025 12:00 AM	2/26/2025 12:00 AM	In Progress	(WATER LEAK) 20805 OAK HILL LN	Utilities	Water Leak	Steve Castro
2/25/2025 12:00 AM	2/25/2025 12:00 AM	Complete	TRUCK 6019 (INTERMITTENT WHOLE TRUCK WILL SHAKE)	Utilities	Other	Joel Peer
2/25/2025 12:00 AM	2/25/2025 12:00 AM	In Progress	(WATER LEAK) 21820 TALLAHASSEE AVE	Utilities	Water Leak	Steve Castro
2/24/2025 12:00 AM	2/27/2025 12:00 AM	Complete	FORCE MAIN PROJECT 2/24/2025 - 2/27/2025	Utilities	Other	Luis Mendoza
2/24/2025 12:00 AM	2/25/2025 12:00 AM	In Progress	(WATER LEAK) 6131 CIMMARON TRL	Utilities	Water Leak	Jamie Nichols
2/24/2025 12:00 AM	2/24/2025 12:00 AM	Pending	(METER SET) 19609 SERENITY LN	Utilities	Other	Jamie Nichols
2/24/2025 12:00 AM	2/25/2025 12:00 AM	In Progress	(SEWER LEAK) 6514 AVENIDA ANN	Utilities	Sewer Leak	Steve Castro
2/24/2025 12:00 AM	2/24/2025 12:00 AM	In Progress	(SEWER SERVICE INSTALL) 3705 BUCKEYE DR	Utilities	Other	Steve Castro
2/24/2025 12:00 AM	2/24/2025 12:00 AM	In Progress	(WATER SERVICE INSTALL) 8405 BAR K RANCH RD	Utilities	Other	Steve Castro
2/24/2025 12:00 AM	2/24/2025 12:00 AM	In Progress	(WATER SERVICE INSTALL) 3705 BUCKEYE DR	Utilities	Other	Steve Castro
2/18/2025 12:00 AM	2/18/2025 12:00 AM	Complete	(WATER LEAK) 21104 SANTA ANA CV	Utilities	Water Leak	Jamie Nichols

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
2/18/2025 12:00 AM	2/18/2025 12:00 AM	In Progress	(SEWER SERVICE LOCATE) 20805 MADISON CV	Utilities	Other	Steve Castro
2/17/2025 12:00 AM	2/17/2025 12:00 AM	In Progress	(SEWER LEAK) 20714 NORTHLAND DR	Utilities	Sewer Leak	Steve Castro
2/17/2025 12:00 AM	2/20/2025 12:00 AM	Complete	FORCE MAIN PROJECT 2/17/2025 - 2/20/2025	Utilities	Other	Luis Mendoza
2/17/2025 12:00 AM	2/17/2025 12:00 AM	In Progress	(WATER LEAK) 6444 MARSHALLS POINT CV (PLANT 3)	Utilities	Other	Steve Castro
2/13/2025 12:00 AM	2/13/2025 12:00 AM	In Progress	(CONCRETE ENCASEMENT) 21604 SURREY LN	Utilities	Other	Luis Mendoza
2/13/2025 12:00 AM	2/13/2025 12:00 AM	In Progress	(CONCRETE APRONS) 8319 TIMBER TRL	Utilities	Other	Luis Mendoza
2/12/2025 12:00 AM	2/12/2025 12:00 AM	Complete	TRUCK 7019 (BRAKES MAKING NOISE)	Utilities	Other	Joel Peer
2/12/2025 12:00 AM	2/12/2025 12:00 AM	Pending	(METER SET) 20201 CONTINENTAL DR	Utilities	Other	Jamie Nichols
2/12/2025 12:00 AM	2/12/2025 12:00 AM	In Progress	(CURBSTOP REPLACEMENT) 7209 COMSTOCK CV	Utilities	Other	Steve Castro
2/12/2025 12:00 AM	2/12/2025 12:00 AM	Complete	(METER SET) 8516 PINE MUHLY DR	Utilities	Other	Jamie Nichols
2/11/2025 12:00 AM	2/11/2025 12:00 AM	In Progress	(METER SET) 22817 GOLDEN DAISY LN	Utilities	Other	Jamie Nichols
2/11/2025 12:00 AM	2/11/2025 12:00 AM	In Progress	(METER SET) 22701 GOLDEN DAISY LN	Utilities	Other	Jamie Nichols
2/11/2025 12:00 AM	2/11/2025 12:00 AM	In Progress	(METER SET) 22813 GOLDEN DAISY LN	Utilities	Other	Jamie Nichols
2/11/2025 12:00 AM	2/11/2025 12:00 AM	Complete	6005 driverside light bulb replacement	Utilities		Joel Peer
2/11/2025 12:00 AM	2/11/2025 12:00 AM	Complete	(WATER LEAK) 5100 COUNTRY CLUB DR	Utilities	Other	Luis Mendoza
2/10/2025 12:00 AM	2/10/2025 12:00 AM	Complete	(Low Pressure) Santa Elena Cir	Utilities	Other	Jamie Nichols
2/10/2025 12:00 AM	2/13/2025 12:00 AM	Complete	TRUCK 7015 (OIL CHANGE)	Utilities	Other	Joel Peer

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
2/10/2025 12:00 AM	2/10/2025 12:00 AM	Complete	Oil Change and Tire Rotation	Utilities	Other	Joel Peer
2/10/2025 12:00 AM	2/10/2025 12:00 AM	Complete	(Grinder Pump Issue) Crockett Ave	Utilities	Other	Jamie Nichols
2/10/2025 12:00 AM	2/10/2025 12:00 AM	Complete	(WATER LEAK) 7625 WHITE OAK DR	Utilities	Water Leak	Luis Mendoza
2/10/2025 12:00 AM	2/13/2025 12:00 AM	Complete	FORCE MAIN PROJECT 2/10/2025 - 2/13/2025	Utilities	Other	Luis Mendoza
2/8/2025 12:00 AM	2/9/2025 12:00 AM	In Progress	(WATER LEAK) 20705 BRIDLE PATH RD	Utilities	Water Leak	Steve Castro
2/6/2025 12:00 AM	2/10/2025 12:00 AM	In Progress	(Water Leak) White Oak Dr	Utilities	Water Leak	Luis Mendoza
2/6/2025 12:00 AM	2/6/2025 12:00 AM	Complete	(WATER LEAK) 20708 DEEP CREEK	Utilities	Water Leak	Luis Mendoza
2/6/2025 12:00 AM	2/6/2025 12:00 AM	In Progress	(WATER LEAK) 20505 HOUSTON CV	Utilities	Other	Steve Castro
2/5/2025 12:00 AM	2/5/2025 12:00 AM	Complete	TRUCK 6019 (TPMS ISSUE)	Utilities	Other	Joel Peer
2/4/2025 12:00 AM	2/4/2025 12:00 AM	Complete	WE	Utilities	Other	Luis Mendoza
2/4/2025 12:00 AM	2/4/2025 12:00 AM	In Progress	(WATER SERVICE INSTALL) 21415 HIGHLAND LAKE DR	Utilities	Other	Steve Castro
2/4/2025 12:00 AM	2/4/2025 12:00 AM	In Progress	(METER SET) 22608 GOLDEN DAISY LN	Utilities	Other	Jamie Nichols
2/3/2025 12:00 AM	2/6/2025 12:00 AM	Complete	FORCE MAIN PROJECT 2/3/2025 - 2/6/2025	Utilities	Other	Luis Mendoza
				Total	45	



Fleet Events By Date Range

Lago Vista

Date Range: 2/1/2025 - 2/28/2025

Date: 2/18/2025

Status: Complete

Assigned To: Joel Peer

Event ID: 7014

Event Type: Maintenance

Work Order ID:

Feature ID: Ford F250 Pickup

Feature Class: Fleet Unit

Fee:

Note: mounted and balanced new tires. driver side left rear has a bent rim. looking for replacement rim.

Total 1