

CITY OF LAGO VISTA WATER & WASTEWATER REPORT

May 2025



Water Production

This Month		Total Production - 44.633 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	16.914 MG	15.540 MG	91.9%	0.729 MG	0.501 MG	0.163 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	29.624 MG	29.093 MG	98.2%	1.265 MG	0.938 MG	0.666 MG
Combined	46.538 MG	44.633 MG	95.9%	1.974 MG	1.440 MG	0.964 MG

Past 12 Months		Total Production - 516.581 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	196.906 MG	183.420 MG	93.2%	0.845 MG	0.503 MG	0.091 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	337.494 MG	333.160 MG	98.7%	1.455 MG	0.913 MG	0.566 MG
Combined	534.401 MG	516.581 MG	96.7%	2.200 MG	1.415 MG	0.888 MG

Waste Water Treatment

This Month		Total Treated - 20.274 MG			
	Treated	Highest Day	Average Day	Lowest Day	
Waste Water Treatment Plant	20.274 MG	0.800 MG	0.654 MG	0.550 MG	

Past 12 Months		Total Treated - 212.803 MG			
	Treated	Highest Day	Average Day	Lowest Day	
Waste Water Treatment Plant	212.803 MG	0.820 MG	0.583 MG	0.440 MG	

Effluent Disposal


This Month		WWTP Plant Permit Total - 20.275 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	1.594 MG	0.121 MG	0.051 MG	0.020 MG	
Cedar Breaks Permit	23.884 MG	1.105 MG	0.770 MG	0.466 MG	
WWTP Plant Permit Total	20.275 MG	0.791 MG	0.654 MG	0.550 MG	
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG	

Past 12 Months		WWTP Plant Permit Total - 212.804 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	42.508 MG	2.892 MG	0.116 MG	0.000 MG	
Cedar Breaks Permit	184.970 MG	1.706 MG	0.507 MG	0.000 MG	
WWTP Plant Permit Total	212.804 MG	0.820 MG	0.583 MG	0.440 MG	
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG	

May 2025

Combined Water Production

This Month

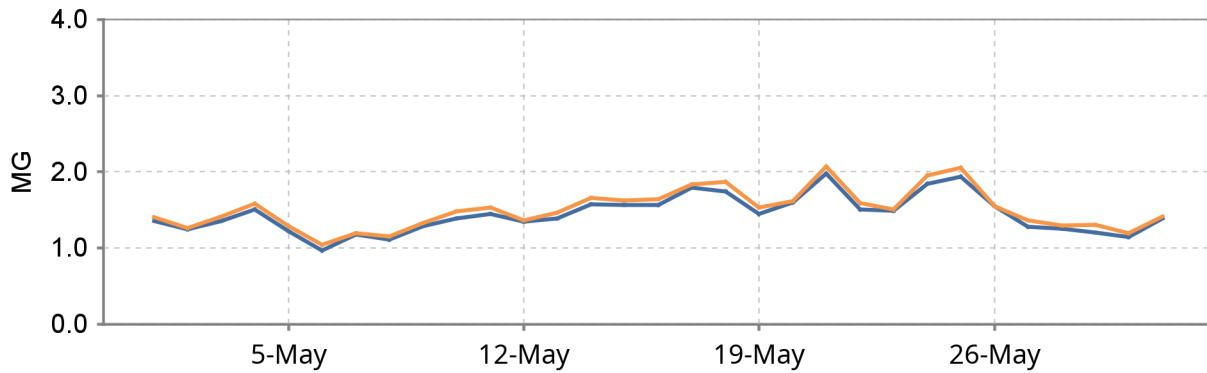


Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
05/01/25	0.269	---	1.132	1.401	0.244	---	1.110	1.353
05/02/25	0.166	---	1.097	1.263	0.163	---	1.081	1.244
05/03/25	0.426	---	0.983	1.409	0.399	---	0.957	1.356
05/04/25	0.436	---	1.148	1.584	0.388	---	1.120	1.508
05/05/25	0.416	---	0.870	1.286	0.376	---	0.843	1.219
05/06/25	0.332	---	0.708	1.040	0.297	---	0.666	0.964
05/07/25	0.509	---	0.683	1.192	0.484	---	0.692	1.177
05/08/25	0.456	---	0.692	1.148	0.391	---	0.718	1.108
05/09/25	0.510	---	0.818	1.328	0.483	---	0.804	1.288
05/10/25	0.592	---	0.887	1.479	0.552	---	0.836	1.388
05/11/25	0.613	---	0.917	1.530	0.541	---	0.903	1.445
05/12/25	0.541	---	0.823	1.365	0.503	---	0.845	1.348
05/13/25	0.623	---	0.843	1.466	0.576	---	0.811	1.386
05/14/25	0.630	---	1.026	1.657	0.581	---	0.990	1.571
05/15/25	0.631	---	0.996	1.627	0.593	---	0.972	1.565
05/16/25	0.608	---	1.032	1.640	0.550	---	1.016	1.565
05/17/25	0.638	---	1.193	1.831	0.593	---	1.202	1.795
05/18/25	0.728	---	1.141	1.868	0.657	---	1.088	1.745
05/19/25	0.621	---	0.911	1.532	0.578	---	0.873	1.450
05/20/25	0.595	---	1.016	1.612	0.564	---	1.038	1.602
05/21/25	0.801	---	1.270	2.071	0.725	---	1.249	1.974
05/22/25	0.441	---	1.151	1.592	0.419	---	1.083	1.502
05/23/25	0.637	---	0.872	1.509	0.583	---	0.904	1.487
05/24/25	0.657	---	1.296	1.954	0.582	---	1.265	1.847
05/25/25	0.780	---	1.271	2.051	0.729	---	1.207	1.936
05/26/25	0.560	---	0.986	1.546	0.523	---	1.022	1.544
05/27/25	0.520	---	0.840	1.360	0.484	---	0.792	1.276
05/28/25	0.535	---	0.761	1.296	0.503	---	0.753	1.256
05/29/25	0.574	---	0.727	1.301	0.495	---	0.711	1.206
05/30/25	0.446	---	0.744	1.190	0.421	---	0.722	1.143
05/31/25	0.624	---	0.788	1.412	0.564	---	0.819	1.384
Total (MG)	16.914	0.000	29.624	46.538	15.540	0.000	29.093	44.633
Highest	0.801	---	1.296	2.071	0.729	---	1.265	1.974
Average	0.546	0.000	0.956	1.501	0.501	0.000	0.938	1.440
Lowest	0.166	---	0.683	1.040	0.163	---	0.666	0.964

May 2025

Water Plant 1 Water Production

This Month

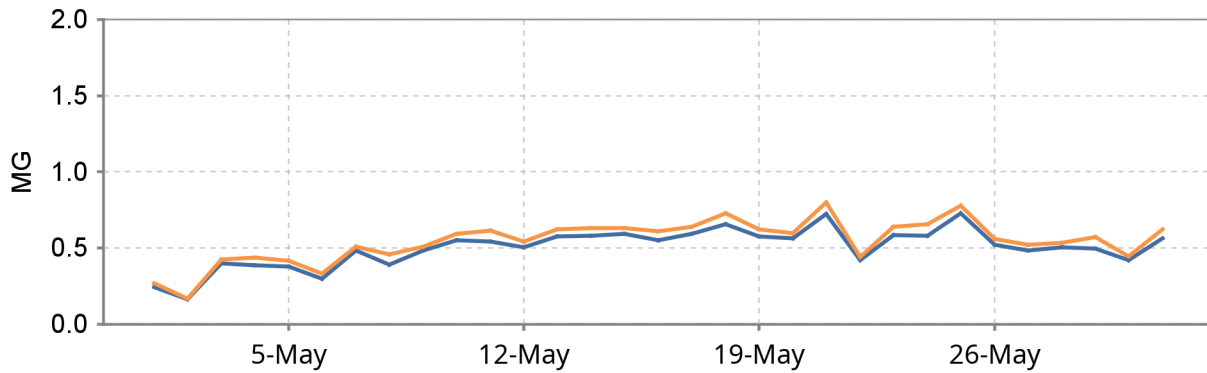


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
05/01/25	0.269	0.000	0.269	0.244	0.026	90%
05/02/25	0.166	0.000	0.166	0.163	0.003	98%
05/03/25	0.426	0.000	0.426	0.399	0.027	94%
05/04/25	0.436	0.000	0.436	0.388	0.048	89%
05/05/25	0.416	0.000	0.415	0.376	0.039	91%
05/06/25	0.332	0.000	0.332	0.297	0.035	90%
05/07/25	0.509	0.000	0.509	0.484	0.024	95%
05/08/25	0.456	0.000	0.456	0.391	0.066	86%
05/09/25	0.510	0.000	0.509	0.483	0.026	95%
05/10/25	0.592	0.000	0.592	0.552	0.040	93%
05/11/25	0.613	0.000	0.613	0.541	0.072	88%
05/12/25	0.541	0.000	0.541	0.503	0.038	93%
05/13/25	0.623	0.000	0.623	0.576	0.048	92%
05/14/25	0.630	0.000	0.630	0.581	0.049	92%
05/15/25	0.631	0.000	0.631	0.593	0.038	94%
05/16/25	0.608	0.000	0.608	0.550	0.058	90%
05/17/25	0.638	0.000	0.638	0.593	0.045	93%
05/18/25	0.728	0.000	0.728	0.657	0.071	90%
05/19/25	0.621	0.000	0.621	0.578	0.044	93%
05/20/25	0.595	0.000	0.595	0.564	0.031	95%
05/21/25	0.801	0.000	0.801	0.725	0.076	91%
05/22/25	0.441	0.000	0.441	0.419	0.022	95%
05/23/25	0.637	0.000	0.637	0.583	0.054	92%
05/24/25	0.657	0.000	0.657	0.582	0.076	88%
05/25/25	0.780	0.000	0.780	0.729	0.051	93%
05/26/25	0.560	0.000	0.560	0.523	0.037	93%
05/27/25	0.520	0.000	0.520	0.484	0.036	93%
05/28/25	0.535	0.000	0.535	0.503	0.032	94%
05/29/25	0.574	0.000	0.574	0.495	0.079	86%
05/30/25	0.446	0.000	0.446	0.421	0.024	95%
05/31/25	0.624	0.000	0.624	0.564	0.060	90%
Total (MG)	16.914	0.000	16.914	15.540	1.374	-
Highest	0.801	0.000	0.801	0.729	-	-
Average	0.546	0.000	0.546	0.501	-	92%
Lowest	0.166	0.000	0.166	0.163	-	-

May 2025

Water Plant 2 Water Production

This Month

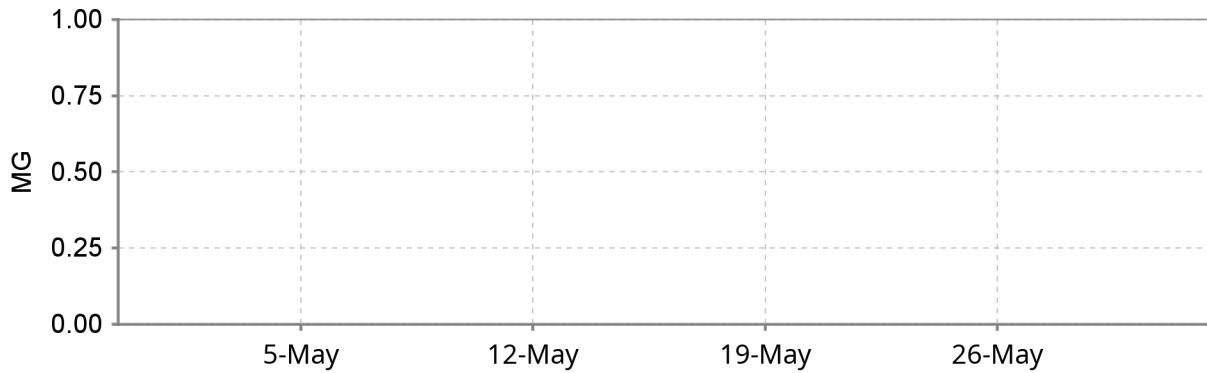


Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
05/01/25	---	---	---	---	---	---	---%
05/02/25	---	---	---	---	---	---	---%
05/03/25	---	---	---	---	---	---	---%
05/04/25	---	---	---	---	---	---	---%
05/05/25	---	---	---	---	---	---	---%
05/06/25	---	---	---	---	---	---	---%
05/07/25	---	---	---	---	---	---	---%
05/08/25	---	---	---	---	---	---	---%
05/09/25	---	---	---	---	---	---	---%
05/10/25	---	---	---	---	---	---	---%
05/11/25	---	---	---	---	---	---	---%
05/12/25	---	---	---	---	---	---	---%
05/13/25	---	---	---	---	---	---	---%
05/14/25	---	---	---	---	---	---	---%
05/15/25	---	---	---	---	---	---	---%
05/16/25	---	---	---	---	---	---	---%
05/17/25	---	---	---	---	---	---	---%
05/18/25	---	---	---	---	---	---	---%
05/19/25	---	---	---	---	---	---	---%
05/20/25	---	---	---	---	---	---	---%
05/21/25	---	---	---	---	---	---	---%
05/22/25	---	---	---	---	---	---	---%
05/23/25	---	---	---	---	---	---	---%
05/24/25	---	---	---	---	---	---	---%
05/25/25	---	---	---	---	---	---	---%
05/26/25	---	---	---	---	---	---	---%
05/27/25	---	---	---	---	---	---	---%
05/28/25	---	---	---	---	---	---	---%
05/29/25	---	---	---	---	---	---	---%
05/30/25	---	---	---	---	---	---	---%
05/31/25	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

May 2025

Water Plant 3 Water Production

This Month

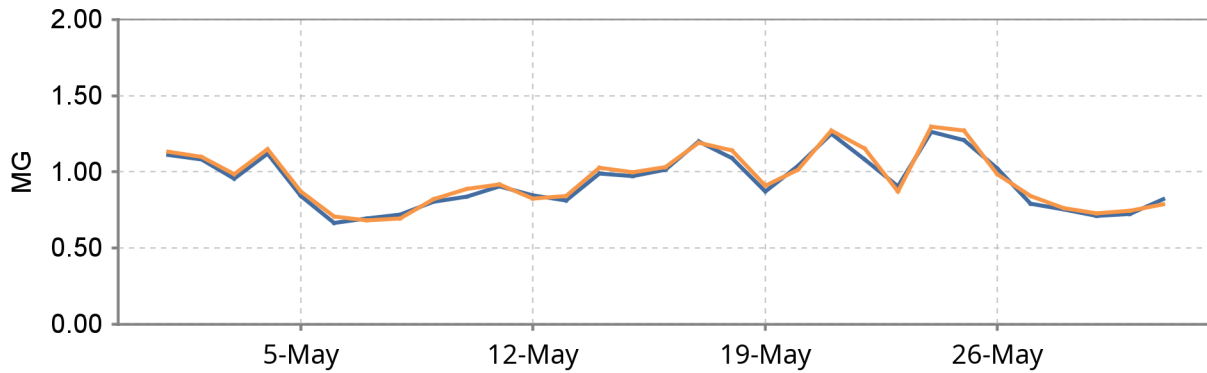


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
05/01/25	1.132	1.193	0.000	0.051	1.110	0.022	98%
05/02/25	1.097	1.102	0.000	0.005	1.081	0.016	99%
05/03/25	0.983	1.021	0.000	0.051	0.957	0.026	97%
05/04/25	1.148	1.141	0.000	0.002	1.120	0.028	98%
05/05/25	0.870	0.929	0.000	0.050	0.843	0.027	97%
05/06/25	0.708	0.680	0.000	0.005	0.666	0.042	94%
05/07/25	0.683	0.704	0.000	0.000	0.692	-0.009	101%
05/08/25	0.692	0.748	0.000	0.044	0.718	-0.026	104%
05/09/25	0.818	0.823	0.000	0.006	0.804	0.014	98%
05/10/25	0.887	0.903	0.000	0.051	0.836	0.051	94%
05/11/25	0.917	0.940	0.000	0.005	0.903	0.014	98%
05/12/25	0.823	0.836	0.000	0.000	0.845	-0.022	103%
05/13/25	0.843	0.884	0.000	0.044	0.811	0.033	96%
05/14/25	1.026	1.018	0.000	0.007	0.990	0.036	96%
05/15/25	0.996	1.054	0.000	0.056	0.972	0.024	98%
05/16/25	1.032	1.036	0.000	0.000	1.016	0.016	98%
05/17/25	1.193	1.226	0.000	0.050	1.202	-0.009	101%
05/18/25	1.141	1.142	0.000	0.000	1.088	0.053	95%
05/19/25	0.911	0.962	0.000	0.054	0.873	0.038	96%
05/20/25	1.016	1.168	0.000	0.157	1.038	-0.021	102%
05/21/25	1.270	1.276	0.000	0.007	1.249	0.021	98%
05/22/25	1.151	1.199	0.000	0.049	1.083	0.068	94%
05/23/25	0.872	0.868	0.000	0.007	0.904	-0.032	104%
05/24/25	1.296	1.348	0.000	0.048	1.265	0.032	98%
05/25/25	1.271	1.294	0.000	0.058	1.207	0.064	95%
05/26/25	0.986	1.040	0.000	0.001	1.022	-0.036	104%
05/27/25	0.840	0.825	0.000	0.000	0.792	0.048	94%
05/28/25	0.761	0.815	0.000	0.051	0.753	0.008	99%
05/29/25	0.727	0.721	0.000	0.001	0.711	0.016	98%
05/30/25	0.744	0.739	0.000	0.000	0.722	0.022	97%
05/31/25	0.788	0.865	0.000	0.052	0.819	-0.032	104%
Total (MG)	29.624	30.498	0.000	0.910	29.093	0.531	-
Highest	1.296	1.348	0.000	0.157	1.265	-	-
Average	0.956	0.984	0.000	0.029	0.938	-	98%
Lowest	0.683	0.680	0.000	0.000	0.666	-	-

May 2025

Waste Water Treatment

This Month

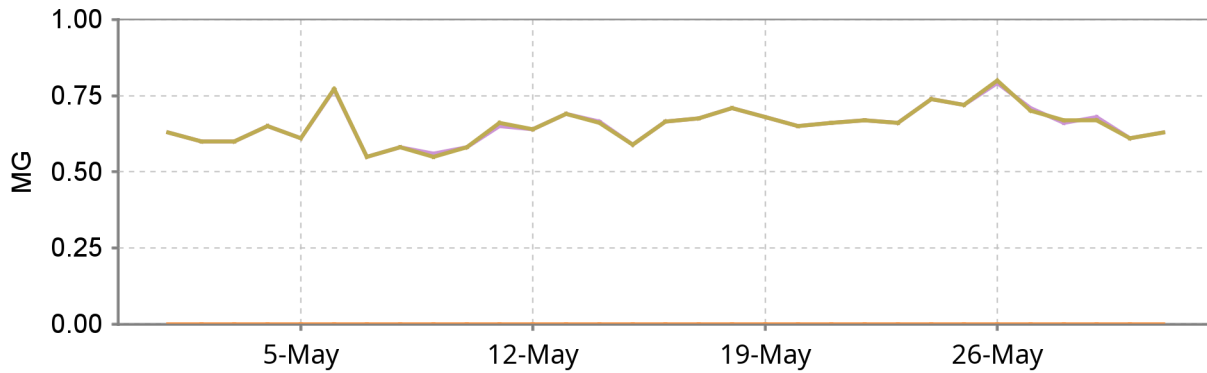


Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
05/01/25	0.630	0.051	0.767	0.630	0.000
05/02/25	0.600	0.050	0.837	0.600	0.000
05/03/25	0.600	0.040	0.826	0.600	0.000
05/04/25	0.650	0.030	0.838	0.650	0.000
05/05/25	0.610	0.030	0.814	0.610	0.000
05/06/25	0.773	0.020	0.549	0.770	0.000
05/07/25	0.550	0.020	0.625	0.550	0.000
05/08/25	0.580	0.020	0.952	0.580	0.000
05/09/25	0.550	0.040	0.831	0.560	0.000
05/10/25	0.580	0.030	0.861	0.580	0.000
05/11/25	0.660	0.030	0.820	0.650	0.000
05/12/25	0.640	0.121	0.872	0.640	0.000
05/13/25	0.690	0.061	0.851	0.690	0.000
05/14/25	0.662	0.078	0.839	0.665	0.000
05/15/25	0.589	0.070	1.105	0.589	0.000
05/16/25	0.666	0.075	0.466	0.666	0.000
05/17/25	0.675	0.076	0.588	0.675	0.000
05/18/25	0.710	0.041	0.580	0.710	0.000
05/19/25	0.679	0.086	0.656	0.679	0.000
05/20/25	0.650	0.071	0.670	0.650	0.000
05/21/25	0.660	0.060	0.824	0.660	0.000
05/22/25	0.670	0.040	0.866	0.670	0.000
05/23/25	0.660	0.071	0.847	0.660	0.000
05/24/25	0.740	0.071	0.844	0.740	0.000
05/25/25	0.720	0.070	0.856	0.720	0.000
05/26/25	0.800	0.050	0.863	0.791	0.000
05/27/25	0.700	0.050	0.723	0.710	0.000
05/28/25	0.670	0.020	0.836	0.660	0.000
05/29/25	0.670	0.030	0.826	0.680	0.000
05/30/25	0.610	0.030	0.513	0.610	0.000
05/31/25	0.630	0.060	0.540	0.630	0.000
Total (MG)	20.274	1.594	23.884	20.275	0.000
Highest	0.800	0.121	1.105	0.791	0.000
Average	0.654	0.051	0.770	0.654	0.000
Lowest	0.550	0.020	0.466	0.550	0.000

May 2025

Effluent Disposal


This Month

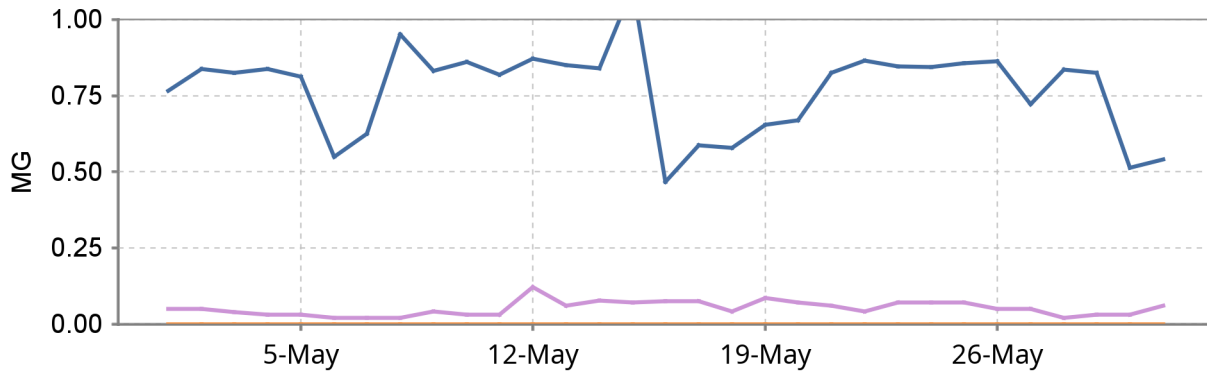

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
05/01/25	0.051	0.051	0.767	0.767	0.000	0.000	0.000	---
05/02/25	0.050	0.050	0.837	0.837	0.000	0.000	0.000	---
05/03/25	0.040	0.040	0.826	0.826	0.000	0.000	0.000	---
05/04/25	0.030	0.030	0.838	0.838	0.000	0.000	0.000	---
05/05/25	0.030	0.030	0.814	0.814	0.000	0.000	0.000	---
05/06/25	0.020	0.020	0.549	0.549	0.000	0.000	0.000	---
05/07/25	0.020	0.020	0.625	0.625	0.000	0.000	0.000	---
05/08/25	0.020	0.020	0.952	0.952	0.000	0.000	0.000	---
05/09/25	0.040	0.040	0.831	0.831	0.000	0.000	0.000	---
05/10/25	0.030	0.030	0.861	0.861	0.000	0.000	0.000	---
05/11/25	0.030	0.030	0.820	0.820	0.000	0.000	0.000	---
05/12/25	0.121	0.121	0.872	0.872	0.000	0.000	0.000	---
05/13/25	0.061	0.061	0.851	0.851	0.000	0.000	0.000	---
05/14/25	0.078	0.078	0.839	0.839	0.000	0.000	0.000	---
05/15/25	0.070	0.070	1.105	1.105	0.000	0.000	0.000	---
05/16/25	0.075	0.075	0.466	0.466	0.000	0.000	0.000	---
05/17/25	0.076	0.076	0.588	0.588	0.000	0.000	0.000	---
05/18/25	0.041	0.041	0.580	0.580	0.000	0.000	0.000	---
05/19/25	0.086	0.086	0.656	0.656	0.000	0.000	0.000	---
05/20/25	0.071	0.071	0.670	0.670	0.000	0.000	0.000	---
05/21/25	0.060	0.060	0.824	0.824	0.000	0.000	0.000	---
05/22/25	0.040	0.040	0.866	0.866	0.000	0.000	0.000	---
05/23/25	0.071	0.071	0.847	0.847	0.000	0.000	0.000	---
05/24/25	0.071	0.071	0.844	0.844	0.000	0.000	0.000	---
05/25/25	0.070	0.070	0.856	0.856	0.000	0.000	0.000	---
05/26/25	0.050	0.050	0.863	0.863	0.000	0.000	0.000	---
05/27/25	0.050	0.050	0.723	0.723	0.000	0.000	0.000	---
05/28/25	0.020	0.020	0.836	0.836	0.000	0.000	0.000	---
05/29/25	0.030	0.030	0.826	0.826	0.000	0.000	0.000	---
05/30/25	0.030	0.030	0.513	0.513	0.000	0.000	0.000	---
05/31/25	0.060	0.060	0.540	0.540	0.000	0.000	0.000	---
Total (MG)	1.594	1.594	23.884	23.884	0.000	0.000	0.000	0.000
Highest	0.121	0.121	1.105	1.105	0.000	0.000	0.000	---
Average	0.051	0.051	0.770	0.770	0.000	0.000	0.000	0.000
Lowest	0.020	0.020	0.466	0.466	0.000	0.000	0.000	---

Combined Water Production


Past 12 Months

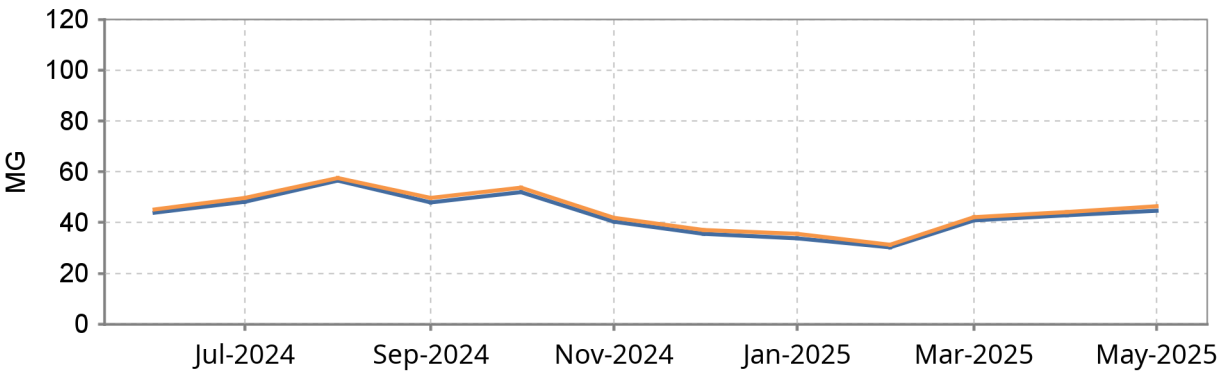

Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
Jun, 2024	17.020	---	28.194	45.214	15.963	---	27.872	43.835
Jul, 2024	18.856	---	30.889	49.745	17.765	---	30.557	48.322
Aug, 2024	21.790	---	35.757	57.547	21.129	---	35.392	56.521
Sep, 2024	21.205	---	28.396	49.601	19.761	---	28.103	47.864
Oct, 2024	23.252	---	30.507	53.759	21.669	---	30.228	51.897
Nov, 2024	17.782	---	23.999	41.782	16.545	---	23.802	40.347
Dec, 2024	15.482	---	21.496	36.978	14.160	---	21.328	35.489
Jan, 2025	11.775	---	23.728	35.503	10.690	---	23.098	33.788
Feb, 2025	8.754	---	22.587	31.341	7.994	---	22.296	30.290
Mar, 2025	12.710	---	29.489	42.199	11.754	---	29.025	40.779
Apr, 2025	11.366	---	32.828	44.194	10.450	---	32.365	42.815
May, 2025	16.914	---	29.624	46.538	15.540	---	29.093	44.633
Total (MG)	196.906	0.000	337.494	534.401	183.420	0.000	333.160	516.581
Highest	23.252	---	35.757	57.547	21.669	---	35.392	56.521
Average	16.409	0.000	28.125	44.533	15.285	0.000	27.763	43.048
Lowest	8.754	---	21.496	31.341	7.994	---	21.328	30.290

Water Plant 1 Water Production


Past 12 Months

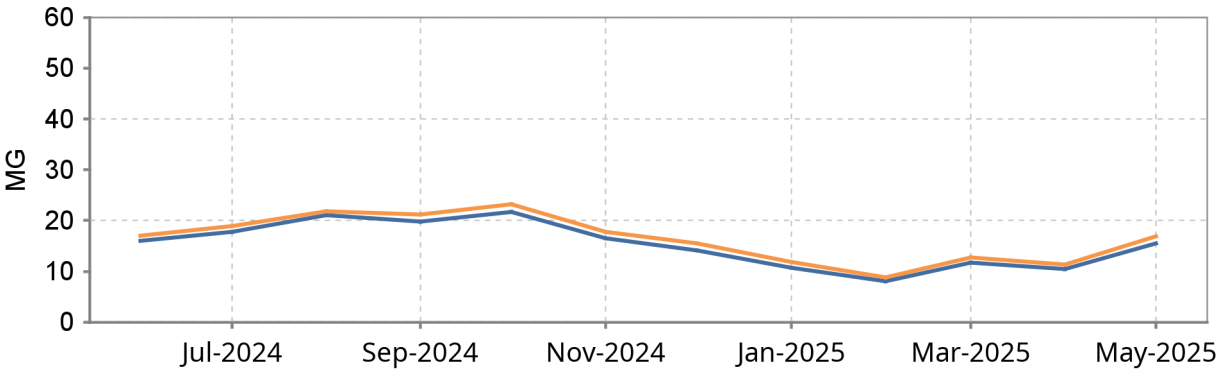

Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
Jun, 2024	17.020	10.271	6.757	15.963	1.057	94%
Jul, 2024	18.856	11.355	7.502	17.765	1.092	94%
Aug, 2024	21.790	11.931	9.852	21.129	0.660	97%
Sep, 2024	21.205	11.803	9.402	19.761	1.444	93%
Oct, 2024	23.252	13.178	10.071	21.669	1.583	93%
Nov, 2024	17.782	10.107	7.674	16.545	1.237	93%
Dec, 2024	15.482	8.354	7.137	14.160	1.322	91%
Jan, 2025	11.775	2.509	9.264	10.690	1.085	91%
Feb, 2025	8.754	0.000	8.753	7.994	0.760	91%
Mar, 2025	12.710	0.001	12.709	11.754	0.956	92%
Apr, 2025	11.366	0.000	11.366	10.450	0.916	92%
May, 2025	16.914	0.000	16.914	15.540	1.374	92%
Total (MG)	196.906	79.510	117.401	183.420	13.486	-
Highest	23.252	13.178	16.914	21.669	-	-
Average	16.409	6.626	9.783	15.285	-	93%
Lowest	8.754	0.000	6.757	7.994	-	-

Water Plant 2 Water Production

Past 12 Months

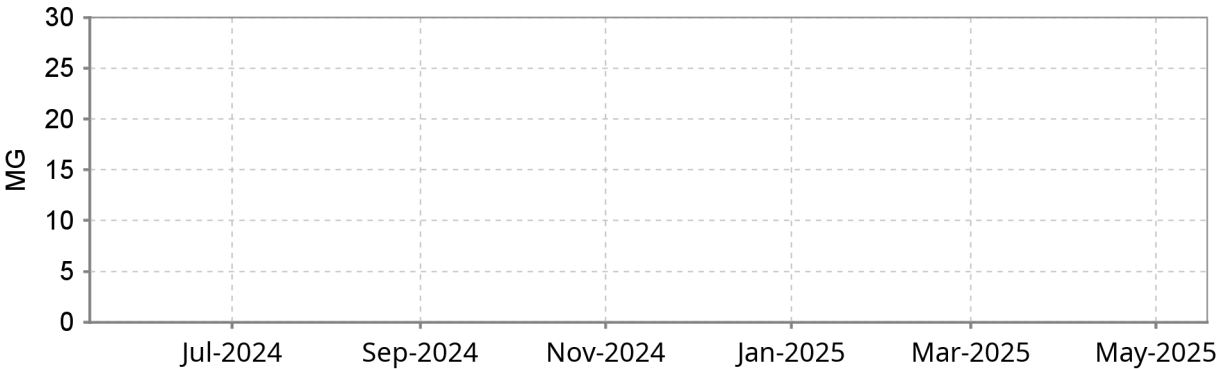


Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
Jun, 2024	---	---	---	---	---	---	---%
Jul, 2024	---	---	---	---	---	---	---%
Aug, 2024	---	---	---	---	---	---	---%
Sep, 2024	---	---	---	---	---	---	---%
Oct, 2024	---	---	---	---	---	---	---%
Nov, 2024	---	---	---	---	---	---	---%
Dec, 2024	---	---	---	---	---	---	---%
Jan, 2025	---	---	---	---	---	---	---%
Feb, 2025	---	---	---	---	---	---	---%
Mar, 2025	---	---	---	---	---	---	---%
Apr, 2025	---	---	---	---	---	---	---%
May, 2025	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

May 2025

Water Plant 3 Water Production

Past 12 Months

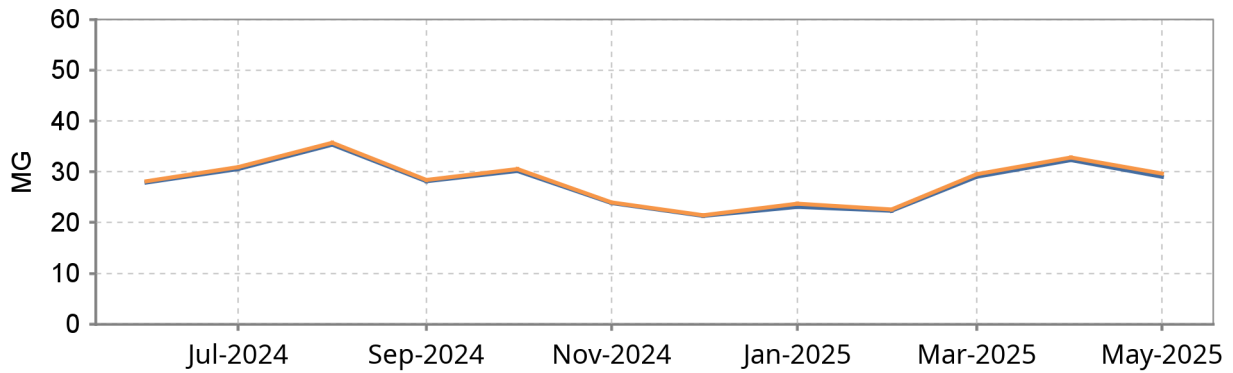


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
Jun, 2024	28.194	28.739	0.000	0.495	27.872	0.322	99%
Jul, 2024	30.889	31.464	0.000	0.495	30.557	0.331	99%
Aug, 2024	35.757	36.729	0.000	0.768	35.392	0.365	99%
Sep, 2024	28.396	29.176	0.000	0.605	28.103	0.293	99%
Oct, 2024	30.507	31.274	0.000	0.656	30.228	0.279	99%
Nov, 2024	23.999	24.710	0.000	0.556	23.802	0.197	99%
Dec, 2024	21.496	22.048	0.000	0.422	21.328	0.168	99%
Jan, 2025	23.728	24.508	0.000	0.790	23.098	0.630	97%
Feb, 2025	22.587	23.460	0.000	0.816	22.296	0.291	99%
Mar, 2025	29.489	30.039	0.000	0.734	29.025	0.464	98%
Apr, 2025	32.828	33.456	0.000	0.740	32.365	0.463	99%
May, 2025	29.624	30.498	0.000	0.910	29.093	0.531	98%
Total (MG)	337.494	346.102	0.000	7.987	333.160	4.334	-
Highest	35.757	36.729	0.000	0.910	35.392	-	-
Average	28.125	28.842	0.000	0.666	27.763	-	99%
Lowest	21.496	22.048	0.000	0.422	21.328	-	-

May 2025

Waste Water Treatment


Past 12 Months

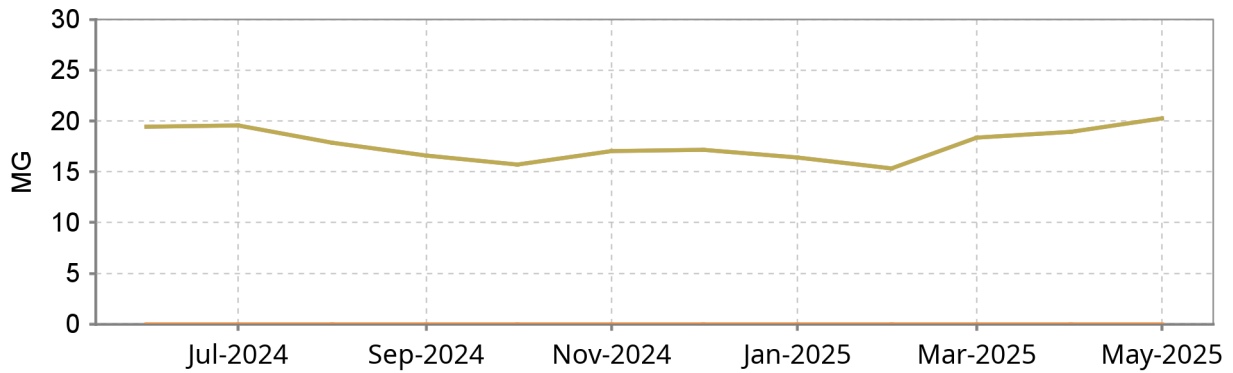

Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
Jun, 2024	19.447	5.109	0.000	19.447	0.000
Jul, 2024	19.570	4.772	0.000	19.570	0.000
Aug, 2024	17.850	5.993	0.000	17.850	0.000
Sep, 2024	16.627	4.633	4.363	16.627	0.000
Oct, 2024	15.722	6.327	23.827	15.722	0.000
Nov, 2024	17.031	4.601	20.445	17.031	0.000
Dec, 2024	17.160	2.608	23.415	17.160	0.000
Jan, 2025	16.439	2.218	25.795	16.440	0.000
Feb, 2025	15.340	2.561	18.584	15.340	0.000
Mar, 2025	18.390	0.539	23.397	18.390	0.000
Apr, 2025	18.953	1.552	21.261	18.952	0.000
May, 2025	20.274	1.594	23.884	20.275	0.000
Total (MG)	212.803	42.508	184.970	212.804	0.000
Highest	20.274	6.327	25.795	20.275	0.000
Average	17.734	3.542	15.414	17.734	0.000
Lowest	15.340	0.539	0.000	15.340	0.000

Effluent Disposal

Past 12 Months

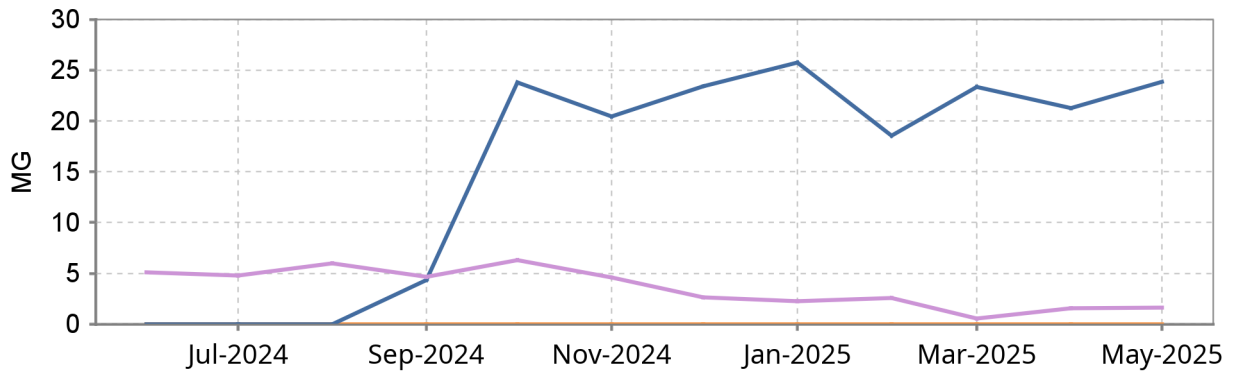


Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
Jun, 2024	5.109	5.109	0.000	0.000	0.000	0.000	0.000	---
Jul, 2024	4.772	4.772	0.000	0.000	0.000	0.000	0.000	---
Aug, 2024	5.993	5.993	0.000	0.000	0.000	0.000	0.000	---
Sep, 2024	4.633	4.633	4.363	4.363	0.000	0.000	0.000	---
Oct, 2024	6.327	6.327	23.827	23.827	0.000	0.000	0.000	---
Nov, 2024	4.601	4.601	20.445	20.445	0.000	0.000	0.000	---
Dec, 2024	2.605	2.608	23.415	23.415	0.000	0.000	0.000	---
Jan, 2025	2.221	2.218	25.795	25.795	0.000	0.000	0.000	---
Feb, 2025	2.561	2.561	18.584	18.584	0.000	0.000	0.000	---
Mar, 2025	0.539	0.539	23.397	23.397	0.000	0.000	0.000	---
Apr, 2025	1.552	1.552	21.261	21.261	0.000	0.000	0.000	---
May, 2025	1.594	1.594	23.884	23.884	0.000	0.000	0.000	---
Total (MG)	42.508	42.508	184.970	184.970	0.000	0.000	0.000	0.000
Highest	6.327	6.327	25.795	25.795	0.000	0.000	0.000	---
Average	3.542	3.542	15.414	15.414	0.000	0.000	0.000	0.000
Lowest	0.539	0.539	0.000	0.000	0.000	0.000	0.000	---

May 2025

Combined Water Production

5 Year Average Daily Production

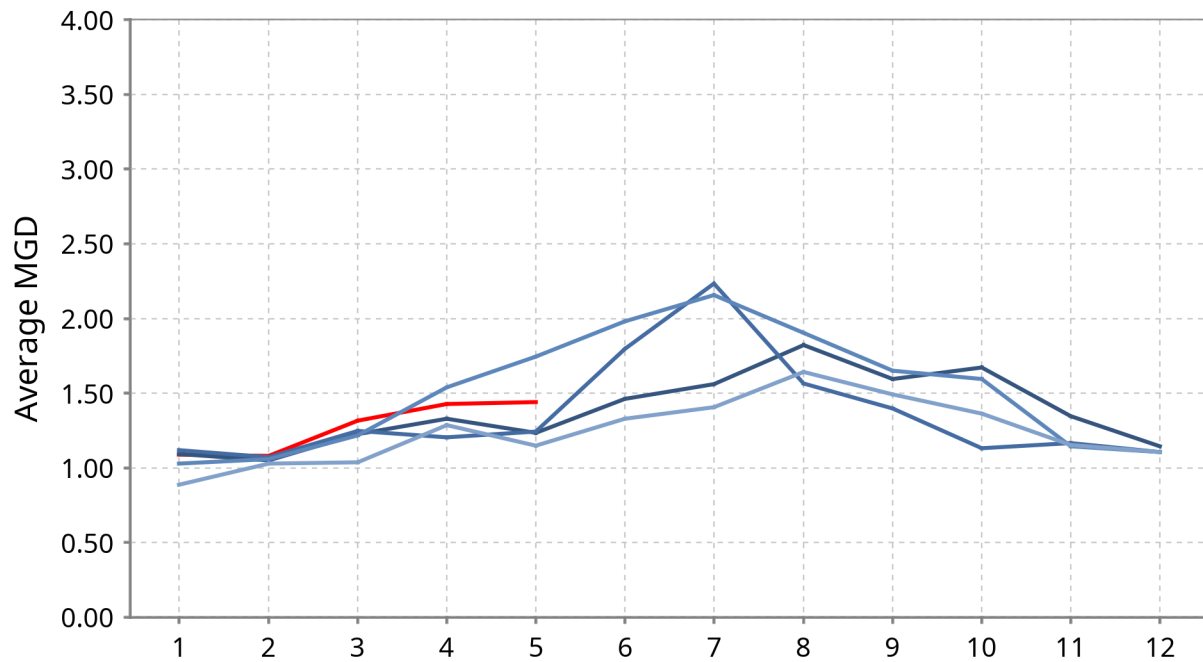


Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.888	1.027	1.118	1.092	1.090
Feb	1.030	1.059	1.073	1.052	1.082
Mar	1.039	1.217	1.246	1.226	1.315
Apr	1.285	1.541	1.205	1.331	1.427
May	1.149	1.744	1.243	1.233	1.440
Jun	1.330	1.982	1.796	1.461	---
Jul	1.407	2.158	2.233	1.559	---
Aug	1.642	1.905	1.563	1.823	---
Sep	1.492	1.652	1.400	1.595	---
Oct	1.365	1.594	1.133	1.674	---
Nov	1.153	1.144	1.166	1.345	---
Dec	1.105	1.108	1.107	1.145	---

Highest	1.642	2.158	2.233	1.823	1.440
Average	1.240	1.511	1.357	1.378	1.271
Lowest	0.888	1.027	1.073	1.052	1.082

Waste Water Treatment

5 Year Average Daily Treated

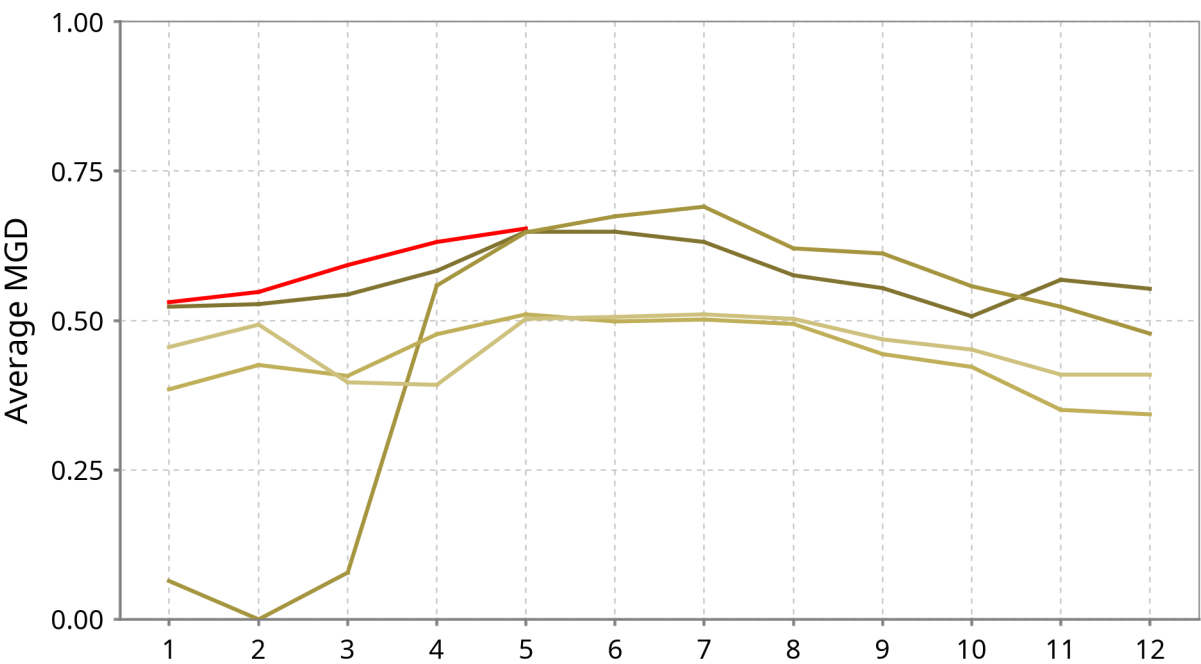

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.456	0.385	0.064	0.523	0.530
Feb	0.493	0.425	0.000	0.528	0.548
Mar	0.396	0.407	0.078	0.543	0.593
Apr	0.392	0.477	0.559	0.583	0.632
May	0.503	0.511	0.648	0.649	0.654
Jun	0.506	0.499	0.675	0.648	---
Jul	0.510	0.502	0.690	0.631	---
Aug	0.503	0.494	0.620	0.576	---
Sep	0.469	0.443	0.612	0.554	---
Oct	0.451	0.422	0.557	0.507	---
Nov	0.409	0.351	0.523	0.568	---
Dec	0.410	0.343	0.478	0.554	---
Highest	0.510	0.511	0.690	0.649	0.654
Average	0.458	0.438	0.459	0.572	0.591
Lowest	0.392	0.343	0.000	0.507	0.530



Work Management Requests

Lago Vista

Date Range: 5/1/2025 - 5/31/2025

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
5/29/2025 12:00 AM	5/29/2025 12:00 AM	Complete	(CURBSTOP REPLACEMENT) 20411 SOUTHBEND	Utilities	Water Leak	Henry Noble
5/29/2025 12:00 AM	5/29/2025 12:00 AM	In Progress	(METER SET) 8008 ROYAL MINT CV	Utilities	Other	Henry Noble
5/29/2025 12:00 AM	5/29/2025 12:00 AM	Complete	(METER SET) 21716 TUSCANY CONEFLOWER	Utilities	Other	Jamie Nichols
5/29/2025 12:00 AM	5/29/2025 12:00 AM	Complete	(METER SET) 7214 COMSTOCK CV	Utilities	Other	Jamie Nichols
5/29/2025 12:00 AM	5/29/2025 12:00 AM	Complete	(METER SET) 8125 LILAC VERBENA PASS	Utilities	Other	Jamie Nichols
5/29/2025 12:00 AM	5/29/2025 12:00 AM	Complete	(METER SET) 8317 ROYAL ELFLOWER RD	Utilities	Other	Jamie Nichols
5/28/2025 12:00 AM	5/28/2025 12:00 AM	Complete	(DRAINAGE ISSUE) SANTA CARLO AVE AND WINTHROP CV	Utilities	Other	Benjamin Moore
5/28/2025 12:00 AM	5/28/2025 12:00 AM	Complete	(DRAINAGE ISSUE) NEWTON DR AND NORRIS CV	Utilities	Other	Luis Mendoza
5/28/2025 12:00 AM	5/28/2025 12:00 AM	Complete	(DRAINAGE ISSUE) BREEDS CV AND BOONE DR	Utilities	Other	Benjamin Moore
5/28/2025 12:00 AM	5/28/2025 12:00 AM	Complete	(SEWER ISSUE) 7817 TURNBACK LEDGE TRL	Utilities	Other	Luis Mendoza
5/28/2025 12:00 AM	5/28/2025 12:00 AM	Complete	(DRAINAGE ISSUE) SANTA ROSA AVE AND WHITNEY CV	Utilities	Other	Luis Mendoza
5/27/2025 12:00 AM	5/27/2025 12:00 AM	Complete	(CURB STOP REPLACEMENT) 7701 DAKOTA CIRCLE	Utilities	Water Leak	Benjamin Moore
5/27/2025 12:00 AM	5/27/2025 12:00 AM	Complete	(WATER SERVICE LEAK) 21107 HIGHLAND LAKE DR 1	Utilities	Water Leak	Luis Mendoza
5/27/2025 12:00 AM	5/27/2025 12:00 AM	Complete	(METER SET) 21216 SANTA ROSA AVE	Utilities	Other	Jamie Nichols
5/27/2025 12:00 AM	5/27/2025 12:00 AM	Complete	(LEAK AT HORNS) 20602 HOOVER CV	Utilities	Other	Benjamin Moore

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
5/22/2025 12:00 AM	5/22/2025 12:00 AM	Complete	(SEWER ISSUE) 21201 WINSLOW CV	Utilities	Other	Luis Mendoza
5/22/2025 12:00 AM	5/22/2025 12:00 AM	Complete	(SINK HOLE) NEVADA CV	Utilities	Other	Luis Mendoza
5/21/2025 12:00 AM	5/27/2025 12:00 AM	In Progress	(WATER MAIN EXTENSION) 2707 WILSON AVE	Utilities	Other	Luis Mendoza
5/21/2025 12:00 AM	5/21/2025 12:00 AM	Complete	(Water Leak) Outpost Trace	Utilities	Water Leak	Steve Castro
5/20/2025 12:00 AM	5/20/2025 12:00 AM	Complete	(SEWER ISSUE) 20708 HARRISON CV	Utilities	Other	Steve Castro
5/20/2025 12:00 AM	5/20/2025 12:00 AM	Complete	(DRAINAGE REPAIR) O'HENRY AVE	Utilities	Other	Luis Mendoza
5/20/2025 12:00 AM	5/21/2025 12:00 AM	Complete	(FH Replacement) Outpost Trace_National Dr	Utilities	FH Issue/Replacement	Luis Mendoza
5/19/2025 12:00 AM	5/20/2025 12:00 AM	Complete	(Fire Hydrant Replacemen) El Dorado	Utilities	FH Issue/Replacement	Luis Mendoza
5/15/2025 12:00 AM	5/15/2025 12:00 AM	Complete	(SINK HOLE) 21414 SANTA CARLO AVE	Utilities	Other	Benjamin Moore
5/14/2025 12:00 AM	5/14/2025 12:00 AM	Complete	(Water Valve Riser Removal) Wagon Wheel	Utilities	Other	Luis Mendoza
5/14/2025 12:00 AM	5/14/2025 12:00 AM	Complete	(Water Valve Riser Removal) Thunderbird_Camel Back	Utilities	Other	Luis Mendoza
5/14/2025 12:00 AM	5/14/2025 12:00 AM	Complete	(Water Valve Riser) Camel Back	Utilities	Other	Luis Mendoza
5/14/2025 12:00 AM	5/14/2025 12:00 AM	Complete	(SEWER ISSUE) 7611 WHITE OAK DR	Utilities	Other	Jamie Nichols
5/13/2025 12:00 AM	5/14/2025 12:00 AM	Complete	(Manhole Riser) Ticonderoga	Utilities	Other	Luis Mendoza
5/13/2025 12:00 AM	5/13/2025 12:00 AM	Complete	(SEWER ISSUE) 22617 GOLDEN DAISY LN	Utilities	Other	Jamie Nichols
5/13/2025 12:00 AM	5/13/2025 12:00 AM	Complete	(VALVE REPAIR) WATER PLANT 1	Utilities	Valve Issue/Exercising	Steve Castro
5/12/2025 12:00 AM	5/13/2025 12:00 AM	Complete	(Manhole Riser) Ticonderoga Ave	Utilities	Other	Luis Mendoza

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
5/12/2025 12:00 AM	5/13/2025 12:00 AM	In Progress	(WW Gravity Inspection) American-Tallahassee Av	Utilities	Other	Benjamin Moore
5/8/2025 12:00 AM	5/8/2025 12:00 AM	Complete	(WATER LEAK) 21201 PALOMINO CV	Utilities	Water Leak	Steve Castro
5/8/2025 12:00 AM	5/13/2025 12:00 AM	Complete	TRUCK 6019 (TPMS, TIRES, FRONT END SHAKES AND AIR & CABIN FILTER REPLACEMENT)	Utilities	Other	Joel Peer
5/5/2025 12:00 AM	5/6/2025 12:00 AM	Complete	FH Replacement: Mount View Dr	Utilities	FH Issue/Replacement	Steve Castro
5/5/2025 12:00 AM		Complete	Orwell Cv Static and FLOW & Surrounding	Utilities	FH Issue/Replacement	Jamie Nichols
5/1/2025 12:00 AM	5/1/2025 12:00 AM	Complete	(ROW CLEARING) PARLIAMENT CV	Utilities	Other	Luis Mendoza
				Total	38	



Fleet Events By Date Range

Lago Vista

Date Range:

5/1/2025 - 5/31/2025

Date: 5/8/2025

Status: Complete

Assigned To: Joel Peer

Event ID: 621E

Event Type: Maintenance

Work Order ID:

Feature ID: Case Loader/Tractor
Articulated 621E

Feature Class: Fleet Unit

Fee:

Note: air filter removed and replaced

Date: 5/13/2025

Status: Complete

Assigned To: Joel Peer

Event ID: 6019

Event Type: Maintenance

Work Order ID:

Feature ID: Chevy 2500 Pickup

Feature Class: Fleet Unit

Fee:

Note: new front brake pads installed, next brake job will need to replace rotors.

Date: 5/28/2025

Status: Complete

Assigned To: Joel Peer

Event ID: 6717

Event Type: Other

Work Order ID:

Feature ID: Chevy Silverado Pickup

Feature Class: Fleet Unit

Fee:

Note: removed nail from front left tire and plugged it. will need tire replaced

Date: 5/1/2025

Status: Complete

Assigned To: Joel Peer

Event ID: mini ex #4

Event Type: Maintenance

Work Order ID:

Feature ID: John Deere Mini Ex

Feature Class: Fleet Unit

Fee:

Note: oil filter and change, fuel filter changed and hydraulic filter changed.

Total

4